



Pietro Cambiaso
Manager of Compliance & Sustainability

Todd Corbin
General Manager

February 15, 2025

Regional Water Quality Control Board, Santa Ana Region

Attention: Ms. Jayne Joy
3737 Main Street, Suite 500
Riverside, California 92501-3348

**Subject: Chino Basin Recycled Water Groundwater Recharge Program:
Quarterly Monitoring Report for October through December 2024**

Dear Ms. Joy,

Inland Empire Utilities Agency and Chino Basin Watermaster hereby submit the *Quarterly Monitoring Report* for the fourth quarter of 2024 (4Q24), October 1 through December 31, 2024, for the *Chino Basin Recycled Water Groundwater Recharge Program*. This document is submitted pursuant to requirements in Order No. R8-2007-0039. All required monitoring and reporting for the quarter are presented in the attached report. During 4Q24, the Groundwater Recharge Program was in compliance with all monitoring and reporting requirements, with the exception of exceedances of the notification level for Perfluorooctanoic acid (PFOA) and secondary MCL for odor.

Chino Basin Watermaster hereby certifies that, during the period of October 1 through December 31, 2024, there was no reported pumping for drinking water purposes in the buffer zones extending 500 feet laterally and 6 months underground travel time from each of the recharge sites using recycled water, namely 7th & 8th Street, Banana, Brooks, Declez, Ely, Hickory, RP3, San Sevaine, Turner, and Victoria Basins. In fact, there are no domestic or municipal production wells in the buffer zones of the aforementioned recharge sites.

DECLARATION

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments thereto; and that, based on my inquiry of the individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.


Executed on the 15th day of February in the Cities of Chino and Rancho Cucamonga.

Pietro Cambiaso, P.E.
Manager of Compliance & Sustainability

Todd Corbin
General Manager

Chino Basin Recycled Water Groundwater Recharge Program

Quarterly Monitoring Report October 1 through December 31, 2024

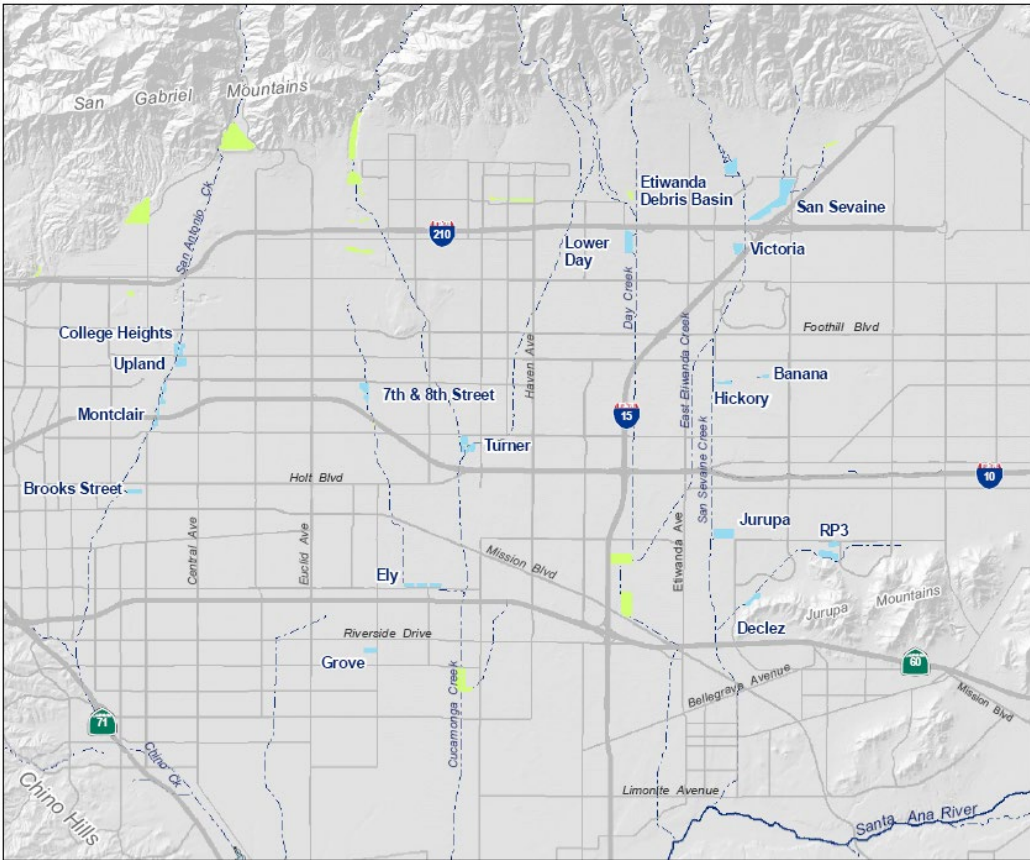

Prepared by:



February 15, 2025

Table of Contents

1. Introduction	1
<i>A. Order No. R8-2007-0039</i>	<i>1</i>
<i>B. Order No. R8-2009-0057</i>	<i>1</i>
<i>C. Revised Monitoring & Reporting Program No. R8-2007-0039</i>	<i>1</i>
<i>D. Title 22, Division 4, Chapter 3. Article 5.1 §60320.100.....</i>	<i>2</i>
<i>E. Outline of the Quarterly Report</i>	<i>2</i>
2. Monitoring Results.....	2
<i>A. Recycled Water: RP-1 and RP-4</i>	<i>2</i>
<i>B. Recycled Water: Alternative Monitoring Plans for TOC and TN.....</i>	<i>6</i>
<i>C. Diluent Water</i>	<i>8</i>
<i>D. Groundwater Monitoring Wells</i>	<i>8</i>
3. Recharge Operations	10
4. Operational Problems & Preventive or Corrective Actions	10
5. Certification of Non-Pumping in the Buffer Zones.....	10
6. MVWD ASR Project	11
7. Exceedance Summary Table.....	11

LIST OF TABLES	
2-1a 2-1b 2-1c	Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality (Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)
2-2	Recycled Water Monitoring: Agency-Wide Flow-Weighted TIN & TDS (Recycled Water Quality Specifications A.6)
2-3a 2-3b	Recycled Water Monitoring: Recycled Water Quality Specifications A.1, A.2, A.3, & A.15
2-4a 2-4b	Recycled Water Monitoring: Remaining Priority Pollutants, EDCs & Pharmaceuticals, and Unregulated Chemicals (Monitoring & Reporting Program)
2-5	Alternative Monitoring Plans: TOC & TN
2-6	RWC, TOC Average, and TN Compliance Summary
2-7a	Diluent Water Monitoring: Local Runoff / Stormwater
2-7b	Diluent Water Monitoring: State Water Project – Silverwood Lake
2-8	Summary of Wells in Groundwater Monitoring Networks
2-9a	Groundwater Monitoring Well Results (Quarterly)
2-9b	Groundwater Monitoring Well Results (Annual)
3-1	Diluent & Recycled Water Recharge Volumes
6-1	MVWD ASR Project - TIN/TDS Mass Balance

LIST OF FIGURES	
1-1	Basin Locations
2-1	Monitoring Well Network: Hickory and Banana Basins
2-2	Monitoring Well Network: Turner Basins
2-3	Monitoring Well Network: 7th & 8th Street Basins
2-4	Monitoring Well Network: Ely Basins
2-5	Monitoring Well Network: Brooks Street Basin
2-6	Monitoring Well Network: Declez and RP3 Basins
2-7	Monitoring Well Network: San Sevaine & Victoria Basins

1. Introduction

Inland Empire Utilities Agency (IEUA), Chino Basin Watermaster (Watermaster), Chino Basin Water Conservation District, and San Bernardino County Flood Control District are partners in the implementation of the Chino Basin Recycled Water Groundwater Recharge Program. This is part of a comprehensive water supply program to enhance water supply reliability and improve the groundwater quality in local drinking water wells throughout the Chino Basin by increasing the recharge of stormwater, imported water and recycled water. This program is an integral part of Watermaster's Optimum Basin Management Program (OBMP).

A. Order No. R8-2007-0039

On June 29, 2007, the Santa Ana Regional Water Quality Control Board (Regional Board) adopted Order No. R8-2007-0039 (Order) which prescribes the requirements for recycled water use for groundwater recharge in 13 recharge sites within the Chino-North Groundwater Management Zone. The locations of recharge basins in the Chino Basin Groundwater Recharge Program are shown in Figure 1-1.

As a provision of this Order, IEUA and Watermaster must also comply with Monitoring and Reporting Program No. R8-2007-0039 (MRP). The MRP includes the water quality monitoring requirements of the Chino Basin Recycled Water Groundwater Recharge Program and the requirement for the submittal of quarterly and annual reports. This document is the quarterly report for the fourth quarter of 2024 (4Q24).

The quarterly report includes the following elements as prescribed in the MRP:

- Monitoring results for recycled water, diluent water, and groundwater.
- Recycled water and diluent water volumes recharged at each basin.
- Reporting of any non-compliance events due to water quality, including records of any operational problems, plant upset and equipment breakdowns or malfunctions, and any diversion(s) of off-specification recycled water and the location(s) of final disposal. All corrective or preventive action(s) taken.
- Certification that no groundwater has been pumped for domestic water supply use from the buffer zone that extends 500 feet and 6-months underground travel time from the recharge basin(s) where recycled water is applied.

B. Order No. R8-2009-0057

On October 23, 2009, the Regional Board adopted Order No. R8-2009-0057, which amended the recharge permit (Order No. R8-2007-0039) by extending the previously 60-month averaging period to 120 months for determining a recharge site's recycled water contribution (RWC). The Order No. R8-2009-0057 also allowed a fraction of the groundwater underflow of the Chino Basin aquifers to be used as a source of diluent water when calculating the running average RWC.

C. Revised Monitoring & Reporting Program No. R8-2007-0039

On October 27, 2010, the Regional Board revised Monitoring and Reporting Program No. R8-2007-0039 (MRP) based on requests for modifications from IEUA and approved by the State Water Resources Control Board – Division of Drinking Water (DDW, formerly California Department of Public Health). The following changes were made to the MRP:

- 1) Sampling Requirements A.3, A.4, and A.5 were modified by specifying that samples shall be collected on a representative day instead of the 10th day.

- 2) Groundwater Monitoring Program Requirement V.1. was modified by adding a sentence to the paragraph that allows IEUA to analyze the groundwater samples collected on a quarterly basis from non-active municipal drinking water wells for dissolved metals, instead of total recoverable metals.
- 3) Reporting Requirement VI.B.3.b. was modified and footnote No. 18 was added to reflect that IEUA uses groundwater monitoring information contained in the *State of the Basin* report prepared on a biennial basis by the Chino Basin Watermaster, amongst other sources, for the annual determination of the recycled water groundwater flow path.

D. Title 22, Division 4, Chapter 3. Article 5.1 §60320.100

On June 18, 2014, the DDW adopted new regulations pertaining to Groundwater Replenishment Reuse Projects (GRRP), which can be found in Title 22 California Code of Regulations, Division 4, Chapter 3. Article 5.1 “Indirect Potable Reuse: Groundwater Replenishment - Surface Application” found in Sections §60320.100 through 60320.130. Pursuant to the new GRRP regulations, additional monitoring and reporting began in 3Q15.

The DDW GRRP regulations require that all GRRPs permitted prior to June 18, 2014 submit a report to the DDW and Regional Board to assess compliance of the existing permit in alignment with the GRRP requirements. The IEUA submitted the Compliance Assessment Report (CAR) for the Chino Basin Recycled Water Groundwater Recharge Project dated June 18, 2015 and a revised CAR dated December 12, 2018. On July 25, 2019, the DDW sent a letter to IEUA with their comments on the CAR. The DDW granted a deadline extension for IEUA to submit responses in an October 21, 2019 email. IEUA responded to the DDW comment letter on November 27, 2019.

E. Outline of the Quarterly Report

Section 2 of this quarterly report discusses the water quality monitoring results for recycled water recharge (water recycling plant effluent, distribution system, and basin surface water), diluent water, and groundwater. Section 3 provides an overview of recharge operations including the volume of diluent water and recycled water recharged. Section 4 describes any operational problems and preventive and/or corrective actions taken. Section 5 contains the certification of non-pumping in the 500-foot buffer zones around each basin. Section 6 is a brief overview of the Monte Vista Water District’s (MVWD) Aquifer Storage and Recovery (ASR) project.

2. Monitoring Results

A. Recycled Water: RP-1 and RP-4

The requirements for recycled water monitoring are described in the MRP. Tables 2-1 through 2-4 include all of the requisite 4Q24 data.

Recycled Water Quality Specifications A.5 through A.9 in the Order are the narrative limits established in the permit. The corresponding monitoring data used to determine compliance with the Order are presented in Tables 2-1 and 2-2. The monitoring data in Table 2-1 is collected from samples of RP-1 and RP-4 effluent. The total nitrogen (TN) limit for recycled water is 10 mg/L based on the DDW GRRP regulations (Title 22 §60320.110). The previous TN limit and method of compliance in the Regional Board’s permit (Order R8-2007-0039) for this recharge program was 5 mg/L using alternative monitoring plans with reduction factors. The assessment of compliance using alternative monitoring plans is described in Section 2.B and Table 2-5 and is included as part of the quarterly reporting until there is a new recycled water recharge permit adopted by the Regional Board. During 4Q24, there were no exceedances of the TN limit. Table 2-2 shows the agency-wide monthly and 12-month running average

concentrations for Total Inorganic Nitrogen (TIN) and Total Dissolved Solids (TDS) with effluent limitations of 8 mg/L and 550 mg/L, respectively. TDS and TIN were not exceeded during 4Q24.

Recycled Water Quality Specifications A.1 through A.4 of the Order are numerical limits based on the Federal and State primary maximum contaminant levels (MCLs), secondary MCLs, and Action Levels. Recycled Water Specification A.15 is a numerical limit for oil and grease.

Table 2-3a shows the results for the DDW approved sample location representative of the recycled water blend from RP-1 and RP-4 used for recharge located at the RP-4 1299 Pressure Zone Pump Station (RW Blend). Table 2-3b shows results for the RP-1 001B effluent. During the CAR review, DDW identified that 001B effluent must be sampled and reported independently of the RW Blend.

In the Order, compliance for all constituents with MCLs or Action Levels is based on a 4-quarter running average (Recycled Water Specifications A.1 through A.4). Table 2-3a (RW Blend) and Table 2-3b (RP-1 001B effluent) summarize the 4-quarter running average concentration for each parameter from 1Q24 through 4Q24 and lists the corresponding compliance limits.

Although the RW Blend sample from the RP-4 1299 Pump Station is a suitable sample location for most constituents in recycled water, it is not appropriate for Total Trihalomethanes (TTHMs) and Total Haloacetic Acids (HAA5). Compliance samples for these compounds are taken from lysimeters or monitoring wells at basins actively receiving recycled water. At these locations, the samples better represent the compounds present in the recycled water prior to reaching the groundwater table, as the concentrations of these constituents change through the recharge process. Once a quarter, a representative sample is collected from a selected compliance lysimeter/monitoring well and analyzed for these compounds. For the 4Q24, IEUA chose the DCZ-LYS-25 lysimeter as the compliance point, as it has received many years of recycled water deliveries. Recycled water was present based on electrical conductivity (EC) measurements.

Tables 2-4a (RW Blend) and 2-4b (RP-1 001B Effluent) summarize the quarterly monitoring results of recycled water for constituents with no MCLs or Action Levels; this includes priority pollutants, chemicals of emerging concern (CECs), and chemicals with state notification levels.

Note that in Tables 2-4a and 2-4b there is a section named “Health-based and performance indicator CECs for Surface Application”, which includes CECs listed as monitoring requirements in the State Water Resources Control Board’s (State Water Board) amendment to the Policy for Water Quality Control for Recycled Water (Recycled Water Policy) adopted on December 11, 2018, and effective as of April 8, 2019. The amendment included updates to the CECs monitoring list based on the 2018 Science Advisory Panel recommendations.

There were no exceedances for the parameters analyzed during 4Q24 in the following categories: primary MCLs for per- and poly-fluoroalkyl substances, *with the exception of PFOA*; inorganic chemicals; volatile organic compounds (VOCs); non-volatile synthetic organic chemicals (SOCs); radionuclides; disinfection byproducts; action levels for lead and copper; notification level chemicals (NLs); secondary MCLs for required constituents, *with the exception of odor*; and oil & grease. PFOA, and odor exceedances are detailed below.

PFOA

In August 2019, the NL for PFOA was lowered from 14 ng/L to 5.1 ng/L and the NL for Perfluorooctanesulfonic acid (PFOS) was lowered from 13 ng/L to 6.5 ng/L. However, since the NLs were lowered during 3Q19, PFOA concentrations in the recycled water have exceeded the NL at both the RW Blend and 001B Effluent sample locations. No confirmation sample was collected within 72 hours of notification of the first results in exceedance, and in accordance with §60320.120(b) weekly sampling began on 10/24/19.

- §60320.120(b)(1) states that “If the running four-week average exceeds the contaminant’s NL, a project sponsor shall describe the reason(s) for the exceedance and provide a schedule for completion of corrective actions in a report submitted to the Regional Board no later than 45 days following the quarter in which the exceedance occurred, with a copy concurrently provided to the Department.” IEUA continued to exceed the four-week average after accelerated monitoring was implemented and the corrective actions report was submitted to the DDW and the Regional Board on February 13, 2020.
- IEUA completed the sixteen consecutive weeks of sampling the RW Blend and 001B Effluent per §60320.120(b)(2) during 1Q20 and notified the DDW and the Regional Board after the final results were received. Notifications of exceedance were emailed to the Regional Board and DDW on February 25, 2020 for the RW Blend and on March 5, 2020 for the 001B Effluent.
- In a March 5, 2020 email, DDW stated that IEUA needs to continue with weekly samples for PFOA in the recycled water. Weekly sampling was reinitiated during the third week of March 2020.
- In a meeting on January 17, 2024, IEUA provided DDW staff with an update on the PFOA Corrective Actions Report. An updated Corrective Actions Report with the University of California Irvine (UCI) PFAS Research Project will be submitted when the final report becomes available. The research project is a sewershed-scale analysis of PFAS in wastewater from domestic, commercial, and industrial sewerage system users. Additionally, IEUA is expanding sewershed monitoring efforts to study PFAS in the IEUA service area.

In April 2024, the Environmental Protection Agency (EPA) set new MCLs for PFOA and PFOS of 4 ng/L that become effective June 25, 2024. In 2Q24, the reporting for PFOA and PFOS was moved to Table No. 2-3a and 2-3b. However, the notification levels were still in effect until the last week of 2Q24.


As shown in the table and chart below, PFOA concentrations sampled at RW Blend continued to exceed the recently adopted MCL 4.0 ng/L. PFOA concentrations sampled at 001B Effluent were below the recently adopted MCL for parts of 4Q24.

Date	RW Blend (ng/L)	4-week avg (ng/L)
01/03/24	7.8	7.4
01/10/24	4.3	6.7
01/17/24	4.0	5.8
01/24/24	7.6	5.9
01/31/24	6.8	5.7
02/07/24	6.9	6.3
02/14/24	9.2	7.6
02/21/24	7.8	7.7
02/28/24	8.5	8.1
03/06/24	6.4	8.0
03/13/24	7.8	7.6
03/20/24	6.3	7.2
03/27/24	9.1	7.4
04/03/24	6.6	7.5
04/10/24	3.7	6.4
04/17/24	3.3	5.7
04/24/24	6.1	4.9
05/01/24	4.4	4.4
05/08/24	6.0	4.9
05/15/24	4.5	5.2

Date	001B Eff (ng/L)	4-week avg (ng/L)
01/03/24	3.7	3.4
01/10/24	3.8	3.7
01/17/24	4.0	3.9
01/24/24	4.8	4.1
01/31/24	4.5	4.3
02/01/24	4.6	4.5
02/14/24	4.8	4.7
02/21/24	4.9	4.7
02/28/24	4.4	4.7
03/06/24	4.5	4.6
03/13/24	4.3	4.5
03/20/24	4.2	4.4
03/27/24	5.9	4.7
04/03/24	5.2	4.9
04/10/24	3.4	4.7
04/17/24	3.5	4.5
04/25/24	5.5	4.4
05/01/24	3.9	4.1
05/08/24	3.7	4.2
05/15/24	4.1	4.3

Date	RW Blend (ng/L)	4-week avg (ng/L)
05/22/24	4.4	4.8
05/29/24	5.7	5.1
06/05/24	6.1	5.2
06/12/24	4.5	5.2
06/19/24	4.8	5.3
06/26/24	5.5	5.2
07/03/24	9.1	6.0
07/10/24	6.0	6.3
07/17/24	4.5	6.3
07/24/24	5.5	6.3
07/31/24	5.0	5.3
08/07/24	5.2	5.1
08/14/24	3.9	4.9
08/21/24	5.3	4.8
08/28/24	9.9	6.0
09/04/24	8.7	6.9
09/11/24	3.9	6.9
09/18/24	5.0	6.9
09/25/24	5.5	5.8
10/02/24	6.2	5.1
10/09/24	5.3	5.5
10/16/24	6.1	5.8
10/23/24	4.1	5.4
10/30/24	4.5	5.0
11/06/24	4.9	4.9
11/13/24	4.0	4.4
11/20/24	4.6	4.5
11/27/24	7.6	5.3
12/04/24	6.3	5.6
12/12/24	8.0	6.6
12/18/24	3.6	6.4
12/24/24	3.7	5.4

Date	001B Eff (ng/L)	4-week avg (ng/L)
05/22/24	3.8	3.9
05/29/24	4.0	3.9
06/05/24	4.2	4.0
06/12/24	4.5	4.1
06/19/24	3.8	4.1
06/26/24	3.5	4.0
07/03/24	3.7	3.9
07/10/24	4.6	3.9
07/17/24	3.9	3.9
07/24/24	4.3	4.1
07/31/24	4.0	4.2
08/07/24	4.1	4.1
08/14/24	3.3	3.9
08/21/24	2.7	3.5
08/28/24	5.0	3.8
09/04/24	4.8	3.9
09/11/24	3.7	4.0
09/18/24	3.7	4.3
09/25/24	4.4	4.1
10/02/24	4.0	3.9
10/09/24	-	-
10/16/24	5.6	4.4
10/23/24	3.8	4.4
10/30/24	4.2	4.4
11/06/24	3.3	4.2
11/13/24	4.0	3.8
11/20/24	3.6	3.8
11/27/24	4.9	3.9
12/04/24	4.3	4.2
12/11/24	4.1	4.2
12/18/24	3.7	4.2
12/24/24	3.5	3.9

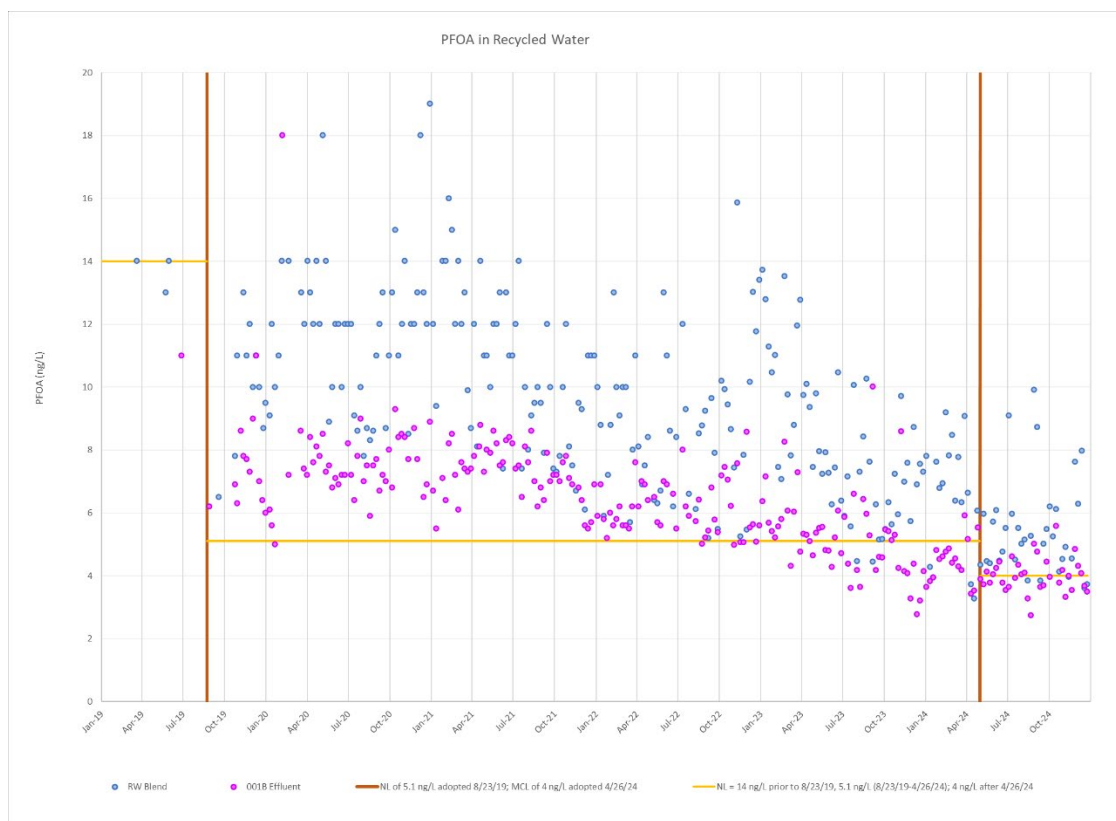

Odor

Odor has a secondary MCL of 3 Threshold Odor Number (TON) in the Recycled Water Specification A.3. The 4-quarter running average (using the four most recent quarterly odor values since odor is an annual monitoring requirement) for 4Q24 were 7 TON and 8 TON at the RW Blend and 001B Effluent, respectively, causing the threshold odor compliance metric to exceed the secondary MCL. Order No. R8-2007-0039 allows compliance for secondary MCLs to be determined at the mound monitoring well. Based on the mound monitoring well data (Table 2-9), threshold odor did not exceed 3 TON at all the nearest downgradient monitoring wells during 4Q24. The 4-quarter running average will remain the same until the next annual sampling is conducted.

B. Recycled Water: Alternative Monitoring Plans for TOC and TN

Total organic carbon (TOC) and nitrogen species sampling and analyses were performed weekly or monthly at lysimeters at some basins when recycled water is being delivered, for the determination of compliance with Recycled Water Specifications A.7 and A.9 of the Order. However, starting 3Q22 all recharge basins have transitioned to alternative monitoring plans to determine compliance with TOC and TN, and lysimeter monitoring is no longer used.

As indicated in Recycled Water Compliance Determination B.5 and B.6 of the Order, alternative monitoring plans to the lysimeter-based compliance sampling for TOC and TN under Recycled Water Specifications A.7 and A.9 can be established upon development of a soil-aquifer treatment factor using recharge demonstration studies. The alternative monitoring plans can be determined in the basin Start-up Period Reports or First Year Operations Reports, and /or subsequent data-based demonstrations for the DDW and the Regional Board. The alternative TOC and TN monitoring plans approved by the Regional Board and DDW include alternative monitoring locations that include: sampling at a recycled water

distribution turnout with the application of a reduction factor. The following are the alternative monitoring plans for each basin:

- 7th & 8th Street Basin: Sampling at the RW Blend with a reduction factor of 93 percent for TOC and 75 percent for TN
- Banana Basin: Sampling at the RW Blend with a reduction factor of 93 percent for TOC and 47 percent for TN
- Brooks Basin: Sampling at the RW Blend with a reduction factor of 92 percent for TOC and 83 percent for TN.
- Declez Basin: Sampling at the RW Blend with a reduction factor of 62 percent for TOC and 91 percent for TN
- Ely Basins: Sampling 001B Effluent with a reduction factor of 86 percent for TOC and 52 percent for TN
- Hickory Basin: Sampling at the RW Blend with a reduction factor of 93 percent for TOC and 27 percent for TN
- RP3 Basin: Sampling at the RW Blend with a reduction factor of 88 percent for TOC and 31 percent for TN
- San Sevaine Basin 1-3: Sampling at the RW Blend with a reduction factor of 92 percent for TOC and 34 percent for TN.
- Turner Basins 1 & 2: Sampling at the RW Blend with a reduction factor of 70 percent for TOC and 87 percent for TN
- Turner Basins 3 & 4: Sampling at the RW Blend with a reduction factor of 85 percent for TOC and 87 percent for TN
- Victoria Basin: Sampling at the RW Blend with a reduction factor of 91 percent for TOC and 82 percent for TN

In June 2015, the DDW issued a letter that approved the request for 50% RWC for most of the basins where recycled water recharge had initiated, with the exception of San Sevaine 5 (no longer being recharged with recycled water) and Turner Basins. The letter stated that based on the data that was provided: “For most of the recharge basins, the data does show an increasing amount of EC and chloride in the mound monitoring wells over time, indicating that recycled water is reaching the mound. Corresponding TOC data from the mound monitoring wells also show a consistent TOC level of less than 1.0 mg/L when recycled water is present; therefore, increasing the RWC limit to 50 percent for some basins is justified.”

In 2Q24, the reduction factors were recalculated for 8th Street, Banana, Brooks, Ely, Hickory, and Victoria Basins to align the TOC compliance locations identified in the abovementioned DDW recommendation letter using the most recent five years of mound monitoring well data available.” For example, something like “In 2Q24 the TOC reduction factors were recalculated for 8th Street, Banana, Brooks, Ely, Hickory, and Victoria Basins due to findings in a 2015 DDW letter that TOC concentrations are less than 1.0 mg/L in concurrence with the presence of recycled water. The reduction factors were recalculated based on the average percent reduction of TOC at the mound monitoring wells for last five years.

During 4Q24, IEUA submitted a request to increase the RWC to 50% and change the TOC compliance locations for Declez and Turner Basins. The DDW requested the previous 52 weeks, the TOC 20-week running average, as monitored pursuant to §60320.118 and comparison to the limit (0.5 mg/L divided by the proposed maximum RWC).

The TOC and TN values calculated based on the alternative monitoring locations and the application of these reduction factors listed above are summarized in Table 2-5. During 4Q24, there were no exceedances of TOC and TN at basins based on the alternative monitoring plans. As part of the CAR review, the DDW identified that the TN limit could not be met using a reduction factor we had previously established for alternative monitoring. The DDW clarified that the 10 mg/L TN limit from the GRRP regulations would need to be met at the recycled water. The recycled water monitoring has met the TN compliance for 4Q24 as demonstrated in Table 2-1. However, alternative monitoring using the reduction factor will continue to be reported for the Regional Board until a new GWR permit is issued.

Table 2-6 is a compliance summary table for RWC, TOC average, and TN compliance. It includes the following: when the basin started receiving recycled water; when the startup period was completed; the RWC limit; the current RWC; the current TOC average limit (based on Recycled Water Specification A.10); compliance with the calculated TOC average limit based on maximum TOC average on a 20-week average and a 4-sample average; compliance with the TN limit, and recharged water monitoring plans for TOC and TN.

C. Diluent Water

In addition to recycled water recharge, the two other recharge water sources are imported water and stormwater / local runoff; these two types of water are considered diluent water. Imported water and stormwater / local runoff must be sampled quarterly in accordance with the DDW-approved Diluent Water Monitoring Plan.

Details on the methods used to measure daily diluent water flow and diluent water monitoring schedule can be found in the Diluent Water Monitoring Plan. The quarterly sampling schedule for stormwater and local runoff is presented in Table 4-2 of the plan. Stormwater is sampled during the rainy season (typically in the 1st and 4th quarters) and local runoff is sampled during the dry season (typically in the 2nd and 3rd quarters). Samples are collected at about half the locations during each seasonal quarter, alternating between even and odd years. Table 5-1 of the plan summarizes the sample type and reporting frequency for the parameters listed in Tables I, II, III, and IV of the Diluent Water Monitoring requirement III.3 of the MRP. For 4Q24, diluent water quality sampling of four local runoff sites was conducted. Table 2-7a lists the results of local runoff sampling and analyses for 4Q24. The maximum level to trigger a source water evaluation was exceeded for PFOA and oil and grease during the 4Q24 monitoring. IEUA has submitted a preliminary evaluation of potential source for all the contaminants where concentrations exceed the maximum level to trigger a source evaluation as part of the CAR and is awaiting a response from DDW regarding the need to complete a source water evaluation.

Table 2-7b lists the results from Metropolitan Water District's (MWD) general mineral and physical analysis of water from Silverwood Lake, the source of imported water for recharge.

D. Groundwater Monitoring Wells

Monitoring is conducted at groundwater monitoring wells quarterly and annually to evaluate groundwater quality conditions in the vicinity of the recharge basins utilizing recycled water. Groundwater monitoring results can be used to assess background conditions, time the arrival of recharge waters, and assess the impact that recharged water has on downgradient water supplies. The wells in the monitoring well networks for Hickory and Banana, Turner, Declez, RP3, 7th & 8th Street, Brooks Street, San Sevaine, Victoria, and Ely Basins are summarized in Table 2-8, and presented on Figures 2-1 through 2-7, respectively. Groundwater quality samples are collected and tested quarterly for all constituents listed in Table 1 of Section V in the MRP R8-2007-0039, and annually for constituents specified in the Phase II Findings of Fact, Attachment A in the permit (Bullet 27 in the Conditions Section). The groundwater constituents analyzed from the monitoring wells during quarterly and annual monitoring are presented in Table 2-9a and Table 2-9b, respectively.

Any 4Q24 sample which exceeded primary or secondary MCLs are shown in Table 2-9a and in Table 2-9b in magenta (primary MCL) and green (secondary MCL) bold italic font. The DDW is notified within 48 hours of receiving the results for primary MCL exceedances or coliform presence at active municipal drinking water wells. Exceedances of primary MCLs and coliform presence at non-drinking water monitoring wells and all secondary MCL exceedances are not reported to the DDW but are reported in the quarterly reports. In 4Q24, the following constituents were detected above the MCLs:

Primary MCL Exceedance

- NO₃-N samples collected from monitoring wells at RP3, Brooks, and Ely were detected above the primary MCL of 10 mg/L. The NO₃-N concentrations at these wells range from 10 to 23 mg/L and are characteristic of groundwater quality in these areas of the Chino Basin. The distribution of NO₃-N concentrations observed at wells in the Chino Basin is summarized in Watermaster’s State of the Basin Reports. No notifications were made to the DDW as these high NO₃-N concentrations are comparable to the ambient NO₃-N concentration in groundwater for each monitoring well’s respective groundwater management zone within the Chino Basin.

Secondary MCL Exceedances

- Turbidity was higher than the secondary MCL of 5 NTU at Alcoa MW1, 8TH-1/1, 8TH-1/2, 8TH-2/2, and SSV-2.
- Manganese was higher than the secondary MCL of 50 µg/L at RP3-1/1.
- TDS was higher than the secondary MCL of 500 mg/L at Alcoa MW1, Alcoa MW3, and Southridge JHS.
- TDS and EC were higher than their secondary MCLs of 500 mg/L and 900 µmhos/cm, respectively, at Alcoa MW3, Alcoa MW1, and Southridge JHS. The wells near the RP3 Basins are located in areas where the TDS and EC concentrations in groundwater are historically elevated. The distribution of TDS concentrations observed at wells in the Chino Basin is summarized in Watermaster’s State of the Basin Reports.

The current State of the Basin Report (2022 State of the Basin) was prepared by West Yost Associates for the CBWM in June 2023. The 2022 State of the Basin report can be downloaded from CBWM’s website, www.cbwm.org.

The 2014 GRRP regulations require two downgradient monitoring wells to be monitored quarterly for Priority Toxic Pollutants, and that the wells are located (A) no less than two weeks but no more than six months of travel through the unsaturated zone affected by the project, and (B) at least 30 days upgradient of the nearest drinking water well be monitored quarterly for Priority Toxic Pollutants. The table below shows the monitoring wells that meet the (A) and (B) criteria specified above.

Basins	Monitoring Well (A)	Monitoring Well (B)
7 th & 8 th Street	8TH-1/2	8TH-2/1
Banana & Hickory	BH-1/2	Reliant Energy – East Well (currently out of service)
Brooks	BRK-1/1	BRK-2/1
Ely	ELY-3	Ely MW2
RP3	RP3-1/1	Southridge JHS
Turner	T-1/2	T-2/2
Victoria & San Sevaine	SSV-2 & VCT-1/1	VCT-2/2
Declez	DCZ-1/1	DCZ-2

Groundwater quality samples are collected and tested annually for constituents specified in the Phase II Findings of Fact, Attachment A in the permit (Bullet 27 in the Conditions Section). The annual groundwater monitoring sampling started during 2Q24 and continued through 4Q24. The groundwater constituents analyzed from the monitoring wells during annual monitoring are presented in Table 2-9b. The exceedances that occurred during the annual monitoring are listed in the Section 7, Exceedance Summary Table.

3. Recharge Operations

IEUA's GWR staff records the daily volumes of water routed to the recharge basins. The 7th & 8th St, Banana, Brooks, Declez, RP3, San Sevaine, and Victoria Basins received recycled water this quarter. Table 3-1 lists the volumes of recycled water and diluent water (imported water and/or local runoff/storm flow) captured during the most recent four quarters at the basins that have initiated recharge using recycled water.

4. Operational Problems & Preventive or Corrective Actions

No operational problems were encountered this quarter; therefore, no corrective actions were necessary for the following: Regional Water Recycling Facilities - RP-1 & RP-4 and recharge operations.

Several monitoring wells were not sampled during 4Q24: Pomona Well 34 has a motor issue that was not resolved during 4Q24; California Speedway – Infield Well has a motor issue that was not resolved during 4Q24; CVWD Well 39 is out of service due to a fire; VCT-2/2 is pending a pump replacement that will take place during 1Q25; and DCZ-1/1 is pending rehabilitation to correct turbidity issues.

5. Certification of Non-Pumping in the Buffer Zones

Watermaster has certified that there was no reported pumping of groundwater in 4Q24 for domestic or municipal use from the buffer zones that extend 500 feet and 6 months underground travel time from the 7th & 8th St, Banana, Brooks, Declez, Ely, Hickory, RP3, San Sevaine, Turner, Victoria Basins. In fact, there are no domestic or municipal production wells within the buffer zones of these aforementioned recharge sites.

IEUA continues to work with the San Bernardino County Department of Environmental Health Services (SBCDEHS) to prevent the drilling and construction of new drinking water wells within the buffer zones. SBCDEHS has initiated control over production well permitting within the buffer zones of all recharge sites through the use of buffer zone maps that utilize the same land coordinate system (Township/ Range/ Section/ 40-acre Parcel) that is used in the permitting process. SBCDEHS reviews new well permit applications, in part, by checking the proposed location of a new drinking water well against recharge basin location maps and parcel lists, both provided by IEUA. The maps and lists show township/range/section parcels (40-acre parcels) that abut recharge basins and their 500-foot buffers.

If a proposed well falls within an abutting parcel, SBCDEHS will review the well location using maps of the basins and buffer zones. If the well falls too near the buffer zone boundary for SBCDEHS to determine the relationship of the proposed well location to the buffer boundary, SBCDEHS will defer to IEUA for a prompt field review of the proposed well location. The field review may include contacting and having the well applicant identify the exact location of the proposed well casing. To conduct a detailed field review, SBCDEHS will contact and provide the IEUA Groundwater Recharge Coordinator with a copy of the well permit application and a timeline for the completion of IEUA's review. Following the review, IEUA will notify SBCDEHS of its findings in writing. IEUA will also notify the DDW and the Regional Board of well permit applications that it recommends should be declined due to well locations determined to fall with a 500-foot buffer zone.

6. MVWD ASR Project

Reporting for the Monte Vista Water District (MVWD) Aquifer Storage and Recovery (ASR) project was allowed by the Regional Board to be included under IEUA/Watermaster Phase I Groundwater Recharge Order No. R8-2005-0033 and subsequent permit updates. In April 2007, MVWD, Watermaster, and IEUA entered into an agreement to report the MVWD ASR project groundwater injection/recovery volumes and TIN/TDS mass balance in the recharge program quarterly reports. Initial injection began in June 2007. Injection activities have been periodic since the program began in 2007. There was no injection activity during 4Q24. Table 6-1 summarizes the monthly volumes and TIN/TDS of injected and recovered water for the last year (1Q24 to 4Q24) and the mass balance of TIN/TDS from the injection-recovery cycles.

7. Exceedance Summary Table

The table below summarizes the recycled water, diluent water, and monitoring well exceedances from 4Q24.

Sample Type	Site	Exceedance
RW	RW Blend	Primary MCL (4.0 ng/L) – PFOA Primary MCL (1 mg/L) – Oil & Grease Secondary MCL (3 TON) – Odor (this will remain until next annual sampling)
RW	001B Effluent	Primary MCL (4.0 ng/L) - PFOA Secondary MCL (3 TON) - Odor (this will remain until next annual sampling)
Diluent-Local Runoff	Cucamonga Creek @ Turner 1&2	Primary MCL (4.0 ng/L) – PFOA
Diluent-Local Runoff	W Cucamonga Creek @ Ely	Primary MCL (4.0 ng/L) – PFOA
Well	Alcoa MW1	Secondary MCL (200 µmhos/cm) - EC Secondary MCL (500 mg/L) – TDS Secondary MCL (5 NTU) – Turbidity
Well	Alcoa MW3	Primary MCL (10 mg/L) – NO ₃ -N Secondary MCL (200 µmhos/cm) - EC Secondary MCL (500 mg/L) - TDS
Well	RP3-1/1	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS Primary MCL (100 µg/L) – Nickel Secondary MCL (50 µg/L) - Mn
Well	Southridge JHS	Primary MCL (10 mg/L) – NO ₃ -N Secondary MCL (200 µmhos/cm) - EC Secondary MCL (500 mg/L) – TDS
Well	8TH-1/1	Primary MCL (100 µg/L) – Nickel Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS Secondary MCL (5 NTU) – Turbidity Secondary MCL (15 units) – Color

Well	8TH-1/2	Primary MCL (100 µg/L) – Nickel Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS Secondary MCL (5 NTU) – Turbidity Secondary MCL (15 units) – Color
Well	8TH-2/1	Primary MCL (4.0 ng/L) – PFOS Primary MCL (10 ng/L) – PFHxS Primary MCL (1 unit) – Hazard Index
Well	8TH-2/2	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS Secondary MCL (5 NTU) – Turbidity
Well	BRK-1/1	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	BRK-1/2	Primary MCL (6 µg/L) – Perchlorate Primary MCL (0.2 µg/L) - Bromochloropropane
Well	BRK-2/1	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS Primary MCL (10 µg/L) – Hexavalent Chromium
Well	BRK-2/2	Primary MCL (4.0 ng/L) – PFOA Primary MCL (10 mg/L) – NO ₃ -N
Well	DCZ-2	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	Ely Basin MW2 Walnut St.	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS Primary MCL (10 mg/L) – NO ₃ -N
Well	ELY-3	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	Bishop of SB Corp-Dom	Primary MCL (10 mg/L) – NO ₃ -N Secondary MCL (500 mg/L) - TDS
Well	SSV-2	Secondary MCL (500 mg/L) - TDS
Well	SS-1/1	Primary MCL (4.0 ng/L) – PFOA
Well	T-1/2	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	T-2/2	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	VCT-1/1	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS
Well	Unitex 91090	Primary MCL (4.0 ng/L) – PFOA Primary MCL (4.0 ng/L) – PFOS

Table 2-1a
 Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for October 2024
 (Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
Limits	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
10/01/24	0.8	6.1				6.9	822			<1	0.6	5.9			7.2	737				<1
10/02/24	0.8	6.0	3.5	4.1	3.6	7.0	845			<1	0.5	5.5	4.7	4.7	7.2	743				<1
10/03/24	0.7	5.3				7.0	836			<1	0.5	5.1			7.1	738				<1
10/04/24	0.6	5.9				7.0	839			<1	0.5	5.1			7.1	740				<1
10/05/24	0.6	6.0				7.0	825			<1	0.5	5.2			7.1	733				<1
10/06/24	0.6	5.9	4.2	4.8	4.2	6.9	841	488	165	<1	0.6	5.6	4.1	4.1	4.1	7.2	733	418	134	<1
10/07/24	0.6	6.3				6.9	805			<1	0.6	5.8			7.2	728				<1
10/08/24	0.6	6.3				6.7	807			<1	0.6	5.6			7.2	728				<1
10/09/24	0.5	6.0	3.8	4.7	3.8	6.8	790			<1	0.5	5.5	4.4	4.6	7.2	736				<1
10/10/24	0.5	5.8				6.9	779			<1	0.6	5.2			7.1	744				<1
10/11/24	0.5	5.9				6.9	801			<1	0.6	5.3			7.1	737				<1
10/12/24	0.5	6.1				7.0	809			<1	0.6	5.5			7.1	739				<1
10/13/24	0.4	5.9	4.4	5.2	4.4	6.9	787			<1	0.6	5.5	3.9	4.7	3.9	7.1	739	412		<1
10/14/24	0.4	6.3				6.9	788	440		<1	0.7	6.0			7.2	745				<1
10/15/24	0.5	6.4				7.0	775			<1	0.7	6.1			7.2	757				<1
10/16/24	0.6	6.0	3.9	4.4	3.9	7.1	783			<1	0.7	6.1	2.0	2.0	7.3	767				<1
10/17/24	0.6	6.0				7.1	775			1	0.8	5.6			7.3	768				<1
10/18/24	0.6	6.2				7.1	768			<1	0.7	5.3			7.3	757				<1
10/19/24	0.7	6.4				7.1	779			1	0.6	5.3			7.4	733				1
10/20/24	0.7	6.5	4.3	4.4	4.3	7.1	768			<1	0.6	5.7	2.9	3.6	2.9	7.3	738	422		<1
10/21/24	0.6	6.9				7.0	762	436		<1	0.7	5.7			7.3	736				<1
10/22/24	0.7	6.2				7.0	782			<1	0.6	5.3			7.3	765				<1
10/23/24	0.7	6.2	3.8	4.5	3.8	7.0	793			<1	0.7	5.5	3.8	3.8	7.3	762				<1
10/24/24	0.7	5.9				7.0	791			<1	0.7	5.4			7.3	753				<1
10/25/24	0.6	6.3				7.0	812			<1	0.7	5.5			7.3	743				<1
10/26/24	0.6	6.1				7.0	817			<1	0.7	5.6			7.3	737				<1
10/27/24	0.6	6.3	5.0	5.2	5.0	7.0	806	416		<1	0.7	5.6	3.9	4.2	3.9	7.3	738	388		1
10/28/24	0.6	6.5				7.0	798			1	0.8	6.0			7.3	735				<1
10/29/24	0.6	6.8				6.9	784			1	0.8	5.8			7.3	742				<1
10/30/24	0.6	6.7	4.6	5.4	4.6	6.9	760			<1	0.7	5.9	4.9		7.2	747				<1
10/31/24	0.6	6.2				7.0	752			<1	0.7	5.5			7.2	742				<1
Avg	0.6	6.2	4.2	4.7	4.2	7.0	796	445	165	<1	0.6	5.6	3.8	4.1	3.7	7.2	743	410	134	<1
Min	0.4	5.3	3.5	4.1	3.6	6.7	752	416	165	<1	0.5	5.1	2.0	3.6	2.0	7.1	728	388	134	<1
Max	0.8	6.9	5.0	5.4	5.0	7.1	845	488	165	1	0.8	6.1	4.9	4.7	4.7	7.4	768	422	134	1

Note: **Bolded characters signify an exceedance of a permit limitation**

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-1b
 Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for November 2024
 (Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
Limits	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
11/01/24	0.6	6.2				7.0	758			<1	0.7	5.6			7.3	740				<1
11/02/24	0.6	6.4				7.1	750			<1	0.7	5.7			7.3	738				<1
11/03/24	0.6	6.6	4.9	5.7	4.9	7.1	761	462	142	<1	0.7	5.6	3.8	4.5	3.8	7.3	742	434	NA	<1
11/04/24	0.6	6.7				7.0	744			1	0.7	6.0			7.3	683				<1
11/05/24	0.6	6.8				6.9	753			<1	0.7	6.0			7.2	639				<1
11/06/24	0.7	6.3	4.2	5.0	4.2	7.0	736			<1	0.6	5.5			7.2	635				<1
11/07/24	0.7	6.0				7.0	745			<1	0.6	5.3	5.7		5.8	7.2	638			<1
11/08/24	0.8	6.2				7.0	748			<1	0.6	5.4			7.2	642				<1
11/09/24	0.8	6.6				7.0	780			<1	0.7	5.6			7.2	652				<1
11/10/24	0.8	6.7				7.0	770			<1	0.7	5.9			7.2	642				<1
11/11/24	0.8	6.8	5.1	5.7	5.1	7.0	756	438		<1	0.7	5.9	3.1	3.8	3.2	7.2	639	420		<1
11/12/24	0.7	6.9				6.9	791			<1	0.7	5.3			7.2	640				<1
11/13/24	0.7	6.8	4.7	5.2	4.7	6.9	810			<1	0.7	5.6	4.0	4.0	4.0	7.1	635			1
11/14/24	0.7	6.7	4.7	5.4	4.7	7.0	788			<1	0.7	5.6			7.2	637				<1
11/15/24	0.7	6.6				7.0	760			<1	0.8	5.7			7.2	636				<1
11/16/24	0.7	6.9				7.0	735			<1	0.7	5.9			7.2	627				2
11/17/24	0.6	7.2	4.4	5.2	4.4	7.0	715	446		2	0.7	6.1	3.6	4.7	3.6	7.1	626	418		<1
11/18/24	0.6	7.2				7.0	744			<1	0.8	6.6			7.2	635				<1
11/19/24	0.6	7.1				6.8	710			<1	0.7	6.2			7.2	638				<1
11/20/24	0.7	7.1	3.7	4.8	3.7	6.9	709			<1	0.8	6.0	4.3		4.3	7.1	638			<1
11/21/24	0.8	7.1				6.9	730			<1	0.8	5.9			7.1	638				<1
11/22/24	0.7	7.0				6.8	726			<1	0.8	5.8			7.1	633				<1
11/23/24	0.7	7.1				6.8	747			<1	0.8	6.0			7.1	641				<1
11/24/24	0.7	7.1	5.2	6.0	5.2	6.9	730	458		1	0.8	6.3	4.3		4.3	7.2	642	428		<1
11/25/24	0.8	7.6				6.9	716			<1	0.8	6.4			7.1	663				<1
11/26/24	0.7	8.0	4.5	5.9	4.6	6.7	733			<1	0.8	6.6			7.0	691				<1
11/27/24	0.8	7.8				6.9	741			<1	0.8	7.1			7.0	695				<1
11/28/24	0.8	7.8				6.9	760			<1	0.8	6.3			7.1	702				<1
11/29/24	0.8	7.1				6.7	762			<1	0.8	6.2			7.1	707				1
11/30/24	0.8	7.2				6.7	775			<1	0.8	6.6			7.1	712				<1
Avg	0.7	6.9	4.6	5.4	4.6	6.9	749	451	142	<1	0.7	6.0	4.1	4.2	4.2	7.2	661	425		<1
Min	0.6	6.0	3.7	4.8	3.7	6.7	709	438	142	<1	0.6	5.3	3.1	3.8	3.2	7.0	626	418		<1
Max	0.8	8.0	5.2	6.0	5.2	7.1	810	462	142	2	0.8	7.1	5.7	4.7	5.8	7.3	742	434		2

Note: **Bolded characters signify an exceedance of a permit limitation**

NA: Lab disposed of sample before running total hardness

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-1c
 Recycled Water Monitoring: RP-1 & RP-4 Effluent Water Quality for December 2024
 (Recycled Water Quality Specifications A.5, A.7, A.8, & A.9)

Unit	RP-1 Effluent (001B Effluent)										RP-4 Effluent									
	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}	Turbidity ^{1,2,7}	TOC	NO ₃ -N	TN	TIN ³	pH ⁷	EC ⁷	TDS ³	Hardness	Coliform ^{1,2,4}
	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL	NTU	mg/L	mg/L	mg/L	mg/L	unit	µhmo/cm	mg/L	mg/L	mpn/100mL
Limits	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240	2;5;10	16 ⁵		10 / 5 ⁶		6<pH<9				2.2;23;240
12/01/24	0.8	7.3				6.8	734	472	140	<1	0.8	6.6	3.9	4.8	3.9	7.1	706	438		<1
12/02/24	0.8	7.7				6.8	706			<1	0.8	6.6				7.0	703			<1
12/03/24	0.8	7.5				6.7	640			<1	0.8	6.6				7.0	707			<1
12/04/24	0.8	7.3	4.9	5.6		6.8	652			<1	0.8	6.1	4.7		4.8	7.0	706			<1
12/05/24	0.7	6.9				6.9	660			1	0.8	6.0				7.0	699			<1
12/06/24	0.7	6.9				6.8	671			<1	0.7	5.8				7.0	694			<1
12/07/24	0.7	7.0				6.8	681			<1	0.7	6.0				7.0	695			<1
12/08/24	0.7	7.2	4.9	5.7	4.9	6.8	674	470		<1	0.7	6.0	3.7	4.5	3.8	7.1	695	420		<1
12/09/24	0.7	7.6				6.8	674			<1	0.7	6.2				7.1	698			<1
12/10/24	0.6	7.2				6.9	674			2	0.7	5.7				7.1	697			<1
12/11/24	0.6	7.1	4.8	5.6	4.8	7.0	655			<1	0.7	5.8	4.7		4.7	7.1	705			<1
12/12/24	0.7	6.7				7.0	644			<1	0.6	5.6				7.1	710			<1
12/13/24	0.7	6.8				7.0	661			<1	0.6	5.7				7.1	704			<1
12/14/24	0.7	7.0				7.1	657			<1	0.6	5.8				7.1	705			<1
12/15/24	0.6	7.0	5.1	5.6	5.1	7.0	645	448		111	0.7	5.7	3.7	4.3	3.8	7.1	696	414		1
12/16/24	0.6	7.6				7.0	634			<1	0.7	6.2				7.2	660			<1
12/17/24	0.7	7.8				6.8	651			<1	0.6	6.0				7.2	630			<1
12/18/24	0.7	7.2	5.7	6.6	5.7	6.9	722			<1	0.6	5.5	4.2		4.3	7.2	604			<1
12/19/24	0.6	7.3				6.8	720			<1	0.5	5.5				7.2	618			<1
12/20/24	0.6	7.0				6.8	714			<1	0.6	5.6				7.2	620		157	<1
12/21/24	0.6	7.1				6.8	704			<1	0.6	5.8				7.3	622			<1
12/22/24	0.5	7.5	4.5	4.9	4.6	6.8	701	452		<1	0.6	6.1	3.4	4.3	3.4	7.3	626	420		<1
12/23/24	0.5	7.5				6.9	698			<1	0.6	5.8				7.2	635			<1
12/24/24	0.6	7.3				6.9	679			<1	0.6	6.7				7.2	663			<1
12/25/24	0.5	6.5	4.6	5.5	4.7	6.9	650			1	0.5	5.8				7.2	661			<1
12/26/24	0.5	6.7				6.9	641			<1	0.5	5.7				7.2	668			<1
12/27/24	0.5	7.1				6.9	662			<1	0.5	6.0				7.2	666			<1
12/28/24	0.5	7.0				6.9	665			<1	0.5	5.9				7.3	666			<1
12/29/24	0.6	7.0	4.6	5.3	4.6	6.9	659	426		2	0.5	5.9	3.2	3.8	3.2	7.3	669	398		<1
12/30/24	0.5	7.3				6.9	665			<1	0.5	5.9				7.1	667			<1
12/31/24	0.5	7.4				6.8	674			<1	0.6	5.9				7.0	663			<1
Avg	0.6	7.2	4.9	5.6	4.9	6.9	673	454	140	<5	0.6	6.0	3.9	4.3	4.0	7.1	673	418	157	<1
Min	0.5	6.5	4.5	4.9	4.6	6.7	634	426	140	<1	0.5	5.5	3.2	3.8	3.2	7.0	604	398	157	<1
Max	0.8	7.8	5.7	6.6	5.7	7.1	734	472	140	111	0.8	6.7	4.7	4.8	4.8	7.3	710	438	157	1

Note: **Bolded characters signify an exceedance of a permit limitation**

Blank cells indicate that analysis was not run for a constituent on that particular date. The data presented meets/exceeds the frequency of analysis specified under the discharge permit for these facilities.

¹ Turbidity and coliform must meet water quality standards for disinfected tertiary treated recycled water, as specified in NPDES No. CA8000409, Order No. R8-2009-0021.

² Turbidity limits: 2 NTU average daily; 5 NTU no more than 5% of day; 10 NTU at any time. Coliform limits: 2.2 MPN/100mL 7-day median; 23 MPN/100mL in no more than 1 sample per month; 240 MPN/100mL at any time.

³ TDS and TIN limits are based on the 12-month running average of the combined effluent from all plants, which are presented in Table 2-2.

⁴ Monthly average for coliform is based on "non-detect" values equal to 2. Determination of "less than" is dependent on the number of "non-detect" occurrences more than half the days in the month.

⁵ TOC shall not exceed 16 mg/L for more than two consecutive samples and an average of the last 4 sample results. TOC compliance can be met at a point prior to reaching the regional groundwater table, including lysimeters.

⁶ DDW limit is 10 mg/L and compliance is evaluated in recycled water samples. RWQCB limit is 5 mg/L and compliance can be evaluated using applied correction factor of alternative monitoring plans

⁷ These values based on continuous monitoring data generated by the Supervisory Control and Data Acquisition (SCADA) system.

Table 2-2
 Recycled Water Monitoring: Agency-Wide Flow-Weighted TIN & TDS (mg/L)
 (Recycled Water Quality Specifications A.6)

Date	TIN		TDS	
	Monthly	12-Mo. Run Avg.	Monthly	12-Mo. Run Avg.
Jan-24	4.7	5.0	469	464
Feb-24	4.1	4.8	475	465
Mar-24	4.1	4.8	479	464
Apr-24	4.8	4.7	488	464
May-24	4.8	4.7	479	466
Jun-24	5.2	4.7	475	468
Jul-24	6.5	4.8	469	470
Aug-24	6.2	5.0	449	470
Sep-24	5.8	5.0	445	469
Oct-24	5.9	5.1	463	470
Nov-24	6.2	5.3	477	471
Dec-24	6.0	5.3	476	470
Avg	5.3	4.9	470	467
Min	4.1	4.7	445	464
Max	6.5	5.3	488	471
Limit		8.0		550

Date source: IEUA NPDES monthly self-monitoring report (MRP No. R8-2009-0021).
 Per the Regional Board, TDS is calculated using the flow-weighted averages based on discharged effluent flows and recycled water flows; TIN is calculated using the flow-weighted averages based on discharged effluent flows only.
 The data reported above will supersede any information submitted for previous quarters. Agency-wide TIN & TDS were in compliance with permit limits at all times.

Table 2-3a
 Recycled Water Monitoring - RW Blend (RP1/RP-4): Primary & Secondary Maximum Contaminant Levels
 (Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	1Q24	2Q24	3Q24	4Q24	4Q Run. Avg. ¹	Limit	Unit	Method
Inorganic Chemicals								
Aluminum	<25	76	61	43	51	1000	µg/L	EPA 200.8
Antimony	<1	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic	<2	<2	<2	<2	<2	10	µg/L	EPA 200.8
Asbestos	NR	NR	NR	NR	<0.19	7	MFL	EPA 100.2
Barium	26	21	20	20	22	1000	µg/L	EPA 200.8
Beryllium	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium	<0.25	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Chromium VI ²	0.3	0.3	0.4	0.4	0.4	10	µg/L	EPA 218.6
Cyanide	<20	<20	<20	<20	<20	150	µg/L	OIA-1677, DW
Fluoride	0.2	0.2	0.2	0.9	0.4	2	mg/L	EPA 300.0
Mercury	<0.5	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.1
Nickel	2	2	3	3	2	100	µg/L	EPA 200.8
Perchlorate	<2	<1	<1	<1	<1	6	µg/L	EPA 314/331.0
Selenium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Thallium	<1	<1	<1	<1	<1	2	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)								
Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropene	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Monochlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl-tert-butyl ether	<0.5	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	<0.5	1.2	<0.5	<0.5	<0.7	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
m,p-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5	1750 ³	µg/L	EPA 524.2
o-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5	1750 ³	µg/L	EPA 524.2
1,2,3-Trichloropropane (added 7/2017)	see 1Q24 text	<0.005	<0.005	<0.005	<0.005	0.005	µg/L	CASRL 524M-TCP
Non-Volatile Synthetic Organic Chemicals (SOCs)								
Alachlor (Alanex)	<1.0	<4	<0.1	<4	<2.3	2	µg/L	EPA 505/508.1
Atrazine	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	<2	18	µg/L	EPA 531.2
Chlordane	<2.5	<2	<2	<2	<2	0.1	µg/L	EPA 505/508.1
2,4-D	<0.4	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	5	4	5	5	5	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1/524.3
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	4	<4	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.05	<0.2	<0.2	<0.2	<0.16	2	µg/L	EPA 505/508.1
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1/524.3
Glyphosate	<5	<25	<25	<25	<20	700	µg/L	EPA 547
Heptachlor	<0.05	<0.02	<0.2	<0.2	<0.12	0.01	µg/L	EPA 505/508.1
Heptachlor Epoxide	<0.05	<0.02	<0.2	<0.2	<0.12	0.01	µg/L	EPA 505/508.1

Table 2-3a
 Recycled Water Monitoring - RW Blend (RP1/RP-4): Primary & Secondary Maximum Contaminant Levels
 (Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	1Q24	2Q24	3Q24	4Q24	4Q Run. Avg. ¹	Limit	Unit	Method
Hexachlorobenzene	<0.5	<1	<0.5	<0.5	<0.6	1	µg/L	EPA 525.2
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2
Lindane	<0.05	<0.2	<0.2	<0.2	<0.16	0.2	µg/L	EPA 505/508.1
Methoxychlor	<0.05	<0.2	<0.2	<0.2	<0.16	30	µg/L	EPA 505/508.1
Molinate	<0.5	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2/508.1
Oxamyl	<2	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<2.5	<2	<10	<2	<4	0.5	µg/L	EPA 505/508.1
PCB 1221	<2.5	<2	<10	<2	<4	0.5	µg/L	EPA 505/508.1
PCB 1232	<2.5	<2	<10	<2	<4	0.5	µg/L	EPA 505/508.1
PCB 1242	<2.5	<2	<10	<2	<4	0.5	µg/L	EPA 505/508.1
PCB 1248	<2.5	<2	<10	<2	<4	0.5	µg/L	EPA 505/508.1
PCB 1254	<2.5	<2	<10	<2	<4	0.5	µg/L	EPA 505/508.1
PCB 1260	<2.5	<2	<10	<2	<4	0.5	µg/L	EPA 505/508.1
Simazine	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<5	<20	<20	<20	<16	3	µg/L	EPA 505/508.1
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (new Federal MCL effective June 25, 2024 are italicized)*								
Perfluorooctanoic acid (PFOA)**	--	7.5	6.0	5.3	6.3	<i>4.0* / 5.1 (NL)</i>	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	--	<2	3.2	<2	<2.4	<i>4.0* / 6.5 (NL)</i>	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	--	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	--	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	--	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	--	<1	<1	<1	<1	<i>1*</i>	unitless	EPA 537.1
Action Level Chemicals								
Copper	5.4	5.4	4.3	4.0	4.0	1300	µg/L	EPA 200.8
Lead	<0.5	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides								
Combined Radium-226 and Radium 228	<3	<3	<3	<3	<3	5	pCi/L	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	<3	15	pCi/L	EPA 900.0/SM7110C
Tritium	<608	<1000	185	<300	<523	20,000	pCi/L	EPA 906
Strontium-90	<3	<2	<2	<2	<2	8	pCi/L	EPA 905
Gross Beta Particle Activity	11	14	13	12	12	50	pCi/L	EPA 900.0
Uranium	<1	<1	<1	<1	<1	20	pCi/L	EPA 200.8
Secondary Maximum Contaminant Level Chemicals								
Aluminum	<25	76	61	43	51	200	µg/L	EPA 200.8
Copper	5.4	5.4	4.3	4.0	4.8	1000	µg/L	EPA 200.8
Corrosivity	-0.4 (Non-Cor.)	-0.1 (Non-Cor.)	-0.3 (Non-Cor.)	-0.8 (Non-Cor.)	Non-Cor.	Non-Cor.	SI	SM 2330B
Foaming Agents (MBAS) ⁴	NR	<0.1	NR	NR	<0.1	0.5	mg/L	S5540C/EPA 425.1
Iron ⁴	20	47	34	26	32	300	µg/L	EPA 200.7
Manganese	10	8	7	9	8	50	µg/L	EPA 200.8
Methyl-tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Odor--Threshold ⁴	NR	4	NR	NR	7	3	TON	SM 2150B
Silver	<0.25	<0.25	<0.25	<0.25	<0.25	100	µg/L	EPA 200.8
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Zinc	52	43	35	35	33	5000	µg/L	EPA 200.8
Miscellaneous Regulated Constituents								
Oil & Grease ⁵	<1	<1 ⁶	<1	1	--	1	mg/L	EPA 1664
Disinfection Byproducts								
Bromate	<0.005	<0.005	<0.005	<0.005	<0.005	0.010	mg/L	EPA 300.1/317
Chlorite	<0.01	0.22	<0.01	<0.01	<0.1	1	mg/L	EPA 300.0
Alternative Compliance Point Data								
	BRK-LYS-25	VCT-1/1	BRK-LYS-25	DCZ-LYS-25	<==TTHMs			
	BRK-LYS-25	VCT-1/1	BRK-LYS-25	DCZ-LYS-25	<==HAA5			
	1Q24	2Q24	3Q24	4Q24				
Total Trihalomethanes (TTHMs)	<2	11	<2	<2	<4	80	µg/L	EPA 524.2
Total Haloacetic Acids (HAA5)	<1	<1	<1	<0.5	<2	60	µg/L	SM 6251B/EPA 552.3

NR: Not required this quarter

¹ 4-quarter running average is calculated based on ND values equal to half the detection limit. The reported 4-quarter running average value, if less than DL, will be based on highest DL found in the data set.

² As of September 11, 2017 the MCL for hexavalent chromium that was established in 2014 is no longer in effect; the State Board does plan on establishing a new MCL in the near future.

³ The sum of m,p-Xylene and o-Xylene is used to calculate compliance for the Total Xylenes limit

⁴ 4-quarter running average is calculated based on the four most recent results. Monitoring is required annually. However, if monitoring takes place more frequently than required, those results will be reported.

⁵ Oil & Grease compliance determination not based on 4-quarter running average

⁶ Oil & Grease additional sampled collected in 3Q24 to compensate for the missed sample in 2Q24.

Bold & yellow highlight signifies an exceedance of a limit in the Order. Explained in further detail in the report text.

Table 2-3b
 Recycled Water Monitoring - RP-1 (001B Effluent): Primary & Secondary Maximum Contaminant Levels
 (Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	1Q24	2Q24	3Q24	4Q24	4Q Run. Avg. ¹	Limit	Unit	Method
Inorganic Chemicals								
Aluminum	128	128	156	125	134	1000	µg/L	EPA 200.8
Antimony	<1	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic	<2	<2	<2	<2	<2	10	µg/L	EPA 200.8
Asbestos	NR	NR	NR	NR	<0.19	7	MFL	EPA 100.2
Barium	13	15	12	15	14	1000	µg/L	EPA 200.8
Beryllium	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium	<0.25	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Chromium VI ²	0.2	0.3	0.3	0.4	0.3	10	µg/L	EPA 218.6
Cyanide	<20	<20	<20	<20	<20	150	µg/L	OIA-1677, DW
Fluoride	0.2	0.2	0.2	0.2	0.2	2	mg/L	EPA 300.0
Mercury	<0.5	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.1
Nickel	3	4	3	3	3	100	µg/L	EPA 200.8
Perchlorate	<2	<1	<1	<1	<1	6	µg/L	EPA 314/331.0
Selenium	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Thallium	<1	<1	<1	<1	<1	2	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)								
Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropene	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Monochlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl-tert-butyl ether	<0.5	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,1,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	0.7	2.1	2.1	2.1	1.7	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
m,p-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5	1750 ³	µg/L	EPA 524.2
o-Xylene	<0.5	<0.5	<0.5	<0.5	<0.5		µg/L	EPA 524.2
1,2,3-Trichloropropane (added 7/2017)	see 1Q24 text	<0.005	<0.005	<0.005	<0.005	0.005	µg/L	CASRL 524M-TCP
Non-Volatile Synthetic Organic Chemicals (SOCs)								
Alachlor (Alanex)	<1	<4	<0.1	<0.1	<1.3	2	µg/L	EPA 505/508.1
Atrazine	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	<2	18	µg/L	EPA 531.2
Chlordane	<2.5	<2	<2.5	<2	<2	0.1	µg/L	EPA 505/508.1
2,4-D	<0.4	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	4	3	4	4	4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	0.6	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	<4	<4	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.05	<0.2	<0.05	<0.2	<0.13	2	µg/L	EPA 505/508.1
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1/524.3
Glyphosate	<5	<25	<25	<25	<20	700	µg/L	EPA 547
Heptachlor	<0.05	<0.2	<0.05	<0.2	<0.13	0.01	µg/L	EPA 505/508.1
Heptachlor Epoxide	<0.05	<0.2	<0.05	<0.2	<0.13	0.01	µg/L	EPA 505/508.1

Table 2-3b
 Recycled Water Monitoring - RP-1 (001B Effluent): Primary & Secondary Maximum Contaminant Levels
 (Recycled Water Quality Specifications A.1, A.2, A.3, A.4 & A.15)

Constituent	1Q24	2Q24	3Q24	4Q24	4Q Run. Avg. ¹	Limit	Unit	Method
Hexachlorobenzene	<0.5	<0.2	<0.5	<0.5	<0.4	1	µg/L	EPA 525.2/508.1
Hexachlorocyclopentadiene	<0.5	<1	<0.5	<0.5	<0.6	50	µg/L	EPA 525.2
Lindane	<0.05	<0.2	<0.05	<0.2	<0.13	0.2	µg/L	EPA 505/508.1
Methoxychlor	<0.05	<0.2	<0.05	<0.2	<0.13	30	µg/L	EPA 505/508.1
Molinate	<0.5	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2
Oxamyl	<2	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<2.5	<2	<5	<10	<5	0.5	µg/L	EPA 505/508.1
PCB 1221	<2.5	<2	<5	<10	<5	0.5	µg/L	EPA 505/508.1
PCB 1232	<2.5	<2	<5	<10	<5	0.5	µg/L	EPA 505/508.1
PCB 1242	<2.5	<2	<5	<10	<5	0.5	µg/L	EPA 505/508.1
PCB 1248	<2.5	<2	<5	<10	<5	0.5	µg/L	EPA 505/508.1
PCB 1254	<2.5	<2	<5	<10	<5	0.5	µg/L	EPA 505/508.1
PCB 1260	<2.5	<2	<5	<10	<5	0.5	µg/L	EPA 505/508.1
Simazine	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<5	<20	<12	<20	<14	3	µg/L	EPA 505/508.1
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
<i>Per- and Poly-fluoroalkyl Substances (new Federal MCL effective June 25, 2024 are italicized)*</i>								
Perfluorooctanoic acid (PFOA)	--	4.9	4.0	4.1	4.3	<i>4.0* / 5.1 (NL)</i>	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	--	5.7	3.0	3.4	4.0	<i>4.0* / 6.5 (NL)</i>	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	--	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	--	2.9	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	--	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	--	<1	<1	<1	<1	<i>1*</i>	unitless	EPA 537.1
Action Level Chemicals								
Copper	4.0	4.1	3.2	3.0	3.1	1300	µg/L	EPA 200.8
Lead	<0.5	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides								
Combined Radium-226 and Radium 228	<3	<3	<3	<3	<3	5	pCi/L	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	<3	15	pCi/L	EPA 900.0/SM7110C
Tritium	239	<1000	40	<300	395	20,000	pCi/L	EPA 906
Strontium-90	<3	<2	<2	<2	<2	8	pCi/L	EPA 905
Gross Beta Particle Activity	14	15	14	14	14	50	pCi/L	EPA 900.0
Uranium	<1	<1	<1	<1	<1	20	pCi/L	EPA 200.8
Secondary Maximum Contaminant Level Chemicals								
Aluminum	128	128	156	125	134	200	µg/L	EPA 200.8
Copper	4.0	4.1	3.2	3.0	3.6	1000	µg/L	EPA 200.8
Corrosivity	-0.3 (Non-Cor.)	-0.3 (Non-Cor.)	-0.4 (Non-Cor.)	-0.6 (Non-Cor.)	Non-Cor.	Non-Cor.	SI	SM 2330B
Foaming Agents (MBAS) ⁴	NR	0.1	NR	NR	0.1	0.5	mg/L	S5540C/EPA 425.1
Iron ⁴	75	69	51	43	60	300	µg/L	EPA 200.7
Manganese	5	6	8	15	8	50	µg/L	EPA 200.8
Methyl-tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Odor--Threshold ⁴	NR	4	NR	NR	8	3	TON	SM 2150B
Silver	<0.25	<0.25	<0.25	<0.25	<0.25	100	µg/L	EPA 200.8
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Zinc	24	29	23	26	20	5000	µg/L	EPA 200.8
Miscellaneous Regulated Constituents								
Oil & Grease ⁵	<1	<1 ⁶	<1	<1	--	1	mg/L	EPA 1664
Disinfection Byproducts								
Bromate	<0.005	<0.005	<0.005	<0.005	<0.005	0.010	mg/L	EPA 300.1/317
Chlorite	<0.1	0.2	<0.01	<0.01	<0.1	1	mg/L	EPA 300.0

NR: Not required this quarter

¹ 4-quarter running average is calculated based on ND values equal to half the detection limit. The reported 4-quarter running average value, if less than DL, will be based on highest DL found in the data set.

² As of September 11, 2017 the MCL for hexavalent chromium that was established in 2014 is no longer in effect; the State Board does plan on establishing a new MCL in the near future.

³ The sum of m,p-Xylene and o-Xylene is used to calculate compliance for the Total Xylenes limit

⁴ 4-quarter running average is calculated based on the four most recent results. Monitoring is required annually. However, if monitoring takes place more frequently than required, those results will be reported.

⁵ Oil & Grease compliance determination not based on 4-quarter running average

⁶ Oil & Grease additional sampled collected in 3Q24 to compensate for the missed sample in 2Q24.

Bold & yellow highlight signifies an exceedance of a limit in the Order. Explained in further detail in the report text.

Table 2-4b

Recycled Water Monitoring - RP-1 (001B Effluent): Remaining Priority Pollutants, EDCs & Pharmaceuticals, and Unregulated Chemicals
(Monitoring & Reporting Program)

Constituent	4Q24	Unit	Method	Constituent	4Q24	Unit	Method	
Volatile Organic Chemicals (VOCs)				Pesticides				
Acrolein	NR	µg/L	EPA 624	Aldrin	NR	µg/L	EPA 505/608	
Acrylonitrile	NR	µg/L	EPA 624	BHC, alpha isomer	NR	µg/L	EPA 525/608	
Bromoform	<0.5	µg/L	EPA 524.2/624	BHC, beta isomer	NR	µg/L	EPA 525/608	
Chlorodibromomethane	2.0	µg/L	EPA 524.2/624	BHC, delta isomer	NR	µg/L	EPA 525/608	
Chloroethane	<0.5	µg/L	EPA 524.2/624	4,4'-DDT	NR	µg/L	EPA 525/608	
2-Chloroethylvinylether	NR	µg/L	EPA 524.2/624	4,4'-DDE	NR	µg/L	EPA 525/608	
Chloroform	62	µg/L	EPA 524.2/624	4,4'-DDD	NR	µg/L	EPA 525/608	
Dichlorobromomethane	13	µg/L	EPA 524.2/624	Dieldrin	NR	µg/L	EPA 505/608	
Methyl Bromide	<0.5	µg/L	EPA 524.2/624	Endosulfan I	NR	µg/L	EPA 525/608	
Methyl Chloride	<0.5	µg/L	EPA 524.2/624	Endosulfan II	NR	µg/L	EPA 525/608	
Acid Extractibles				Endosulfan Sulfate	NR	µg/L	EPA 525/608	
2-Chlorophenol	NR	µg/L	EPA 625	Chemicals w/ State Notification Levels (NLs)			NL	
2,4-Dichlorophenol	NR	µg/L	EPA 625	Boron	0.2	mg/L	EPA 200.7	1
2,4-Dimethylphenol	NR	µg/L	EPA 625	n-butylbenzene	<0.5	µg/L	EPA 524.2	260
2-Methyl-4,6-dinitrophenol	NR	µg/L	EPA 625	sec-butylbenzene	<0.5	µg/L	EPA 524.2	260
2,4-Dinitrophenol	NR	µg/L	EPA 625	tert-butylbenzene	<0.5	µg/L	EPA 524.2	260
2-Nitrophenol	NR	µg/L	EPA 625	Carbon disulfide	<0.5	µg/L	EPA 524.2	160
4-Nitrophenol	NR	µg/L	EPA 625	Chlorate* (001B Eff / DCZ-LYS-25)	291 / <10	µg/L	EPA 300.0	800
4-Chloro-3-methylphenol	NR	µg/L	EPA 625	2-Chlorotoluene	<0.5	µg/L	EPA 524.2	140
Phenol	NR	µg/L	EPA 625	4-Chlorotoluene	<0.5	µg/L	EPA 524.2	140
2,4,6-Trichlorophenol	NR	µg/L	EPA 625	Diazinon	<0.5	µg/L	EPA 525.2	1.2
Base/Neutral Extractibles				Dichlorodifluoromethane (Freon 12)	<0.5	µg/L	EPA 524.2	1000
Acenaphthene	NR	µg/L	EPA 625	1,4 - Dioxane	0.3	µg/L	EPA 522	1
Acenaphthylene	NR	µg/L	EPA 625	Ethylene glycol	<10	mg/L	EPA 8015B	14
Anthracene	NR	µg/L	EPA 625	Formaldehyde	40	µg/L	EPA 556	100
Benzidine	NR	µg/L	EPA 625	HMX	<10	µg/L	EPA 8330B	350
Benzo(a)anthracene	NR	µg/L	EPA 625	Isopropylbenzene	<0.5	µg/L	EPA 524.2	770
Benzo(b)fluoranthene	NR	µg/L	EPA 625	Manganese	15	µg/L	EPA 200.8	500
Benzo(g,h,i)perylene	NR	µg/L	EPA 625	Methyl isobutyl ketone (MIBK)	<2	µg/L	EPA 524.2	120
Benzo(k)fluoranthene	NR	µg/L	EPA 625	Naphthalene	<0.5	µg/L	EPA 524.2	17
Bis(2-chloroethoxy)methane	NR	µg/L	EPA 625	N-Nitrosodiethylamine (NDEA)	<2	ng/L	EPA 521	10
Bis(2-chloroethyl)ether	NR	µg/L	EPA 625	N-Nitrosodimethylamine (NDMA)	<2	ng/L	EPA 521	10
Bis(2-chloroisopropyl)ether	NR	µg/L	EPA 625	N-Nitrosodi-n-propylamine (NDPA)	<2	ng/L	EPA 521	10
4-Bromophenyl phenyl ether	NR	µg/L	EPA 625	Propachlor	<0.5	µg/L	EPA 525.2	90
Butyl benzyl phthalate	NR	µg/L	EPA 625	N-propylbenzene	<0.5	µg/L	EPA 524.2	200
2-Chloronaphthalene	NR	µg/L	EPA 625	RDX	<20	µg/L	EPA 524.4	200
4-Chlorophenyl phenyl ether	NR	µg/L	EPA 625	Tertiary butyl alcohol	4.5	µg/L	EPA 524.2	12
Chrysene	NR	µg/L	EPA 625	1,2,4-trimethylbenzene	<0.5	µg/L	EPA 524.2	330
Dibenzo(a,h)anthracene	NR	µg/L	EPA 625	1,3,5-trimethylbenzene	<0.5	µg/L	EPA 524.2	330
1,3-Dichlorobenzene	NR	µg/L	EPA 625	2,4,6-Trinitrotoluene	<10	µg/L	EPA 8330B	1
3,3-Dichlorobenzidine	NR	µg/L	EPA 625	Vanadium	<5	µg/L	EPA 200.8	50
Diethyl phthalate	NR	µg/L	EPA 625	Health-based and performance indicator CECs for Surface Application			RP3-1/1	
Dimethyl phthalate	NR	µg/L	EPA 625	1,4 - Dioxane	0.3	µg/L	EPA 522	0.2
Di-n-butyl phthalate	NR	µg/L	EPA 625	N-nitrosodimethylamine (NDMA)	<2	ng/L	EPA 521	<2
2,4-Dinitrotoluene	NR	µg/L	EPA 625	N-Nitrosomorphine	7.0	ng/L	EPA 521	<2
2,6-Dinitrotoluene	NR	µg/L	EPA 625	Perfluorooctanesulfonic acid (PFOS)	4.1	ng/L	EPA 537.1	6.0
Di-n-octyl phthalate	NR	µg/L	EPA 625	Perfluorooctanoic acid (PFOA)	3.4	ng/L	EPA 537.1	5.3
Azobenzene	NR	µg/L	EPA 625	Gemfibrozil	<4	ng/L	LC-MS-MS	<4
Fluoranthene	NR	µg/L	EPA 625	Iohexol	48000	ng/L	LC-MS-MS	100
Fluorene	NR	µg/L	EPA 625	Sucralose	91000	ng/L	LC-MS-MS	37000
Hexachlorobutadiene	NR	µg/L	EPA 625	Sulfamethoxazole	4.3	ng/L	LC-MS-MS	28
Hexachlorocyclopentadiene	NR	µg/L	EPA 625	ER-α	NA	ng/L	Trussell Tech	NA
Hexachloroethane	NR	µg/L	EPA 625	AhR (method pending approval)	--	ng/L	Trussell Tech	--
Indeno(1,2,3-cd)pyrene	NR	µg/L	EPA 625	Bold & yellow highlight signifies an exceedance of a limit				
Isophorone	NR	µg/L	EPA 625	NA: Not available from contract lab at time of reporting				
Naphthalene	NR	µg/L	EPA 625					
Nitrobenzene	NR	µg/L	EPA 625					
N-Nitroso-di-n-propylamine	NR	µg/L	EPA 625					
N-Nitrosodiphenylamine	NR	µg/L	EPA 625					
Phenanthrene	NR	µg/L	EPA 625					
Pyrene	NR	µg/L	EPA 625					

NR: Not Required (Annual Requirement, Phase II FOF, Attachment A, Page 26, Item 19)

*Pursuant to the GRRP regulations, recharge water may be monitored at a monitoring well or lysimeter in lieu of recycled water for DDW-specified chemicals having notification levels.

**PFOA is being analyzed weekly for the exceedance of the NL and is reported in Section 2A of this report

Table 2-4a

Recycled Water Monitoring - RW Blend (RP1/RP-4): Remaining Priority Pollutants, EDCs & Pharmaceuticals, and Unregulated Chemicals
(Monitoring & Reporting Program)

Constituent	4Q24	Unit	Method	Constituent	4Q24	Unit	Method		
Volatile Organic Chemicals (VOCs)				Pesticides					
Acrolein	NR	µg/L	EPA 624	Aldrin	NR	µg/L	EPA 505/525/608		
Acrylonitrile	NR	µg/L	EPA 624	BHC, alpha isomer	NR	µg/L	EPA 525/608		
Bromoform	<0.5	µg/L	EPA 524.2/624	BHC, beta isomer	NR	µg/L	EPA 525/608		
Chlorodibromomethane	1.9	µg/L	EPA 524.2/624	BHC, delta isomer	NR	µg/L	EPA 525/608		
Chloroethane	<0.5	µg/L	EPA 524.2/624	4,4'-DDT	NR	µg/L	EPA 525/608		
2-Chloroethylvinylether	NR	µg/L	EPA 524.2/624	4,4'-DDE	NR	µg/L	EPA 525/608		
Chloroform	100	µg/L	EPA 524.2/624	4,4'-DDD	NR	µg/L	EPA 525/608		
Dichlorobromomethane	17	µg/L	EPA 524.2/624	Dieldrin	NR	µg/L	EPA 505/525/608		
Methyl Bromide	<0.5	µg/L	EPA 524.2/624	Endosulfan I	NR	µg/L	EPA 525/608		
Methyl Chloride	<0.5	µg/L	EPA 524.2/624	Endosulfan II	NR	µg/L	EPA 525/608		
Acid Extractibles				Chemicals w/ State Notification Levels (NLs)				NL	
2-Chlorophenol	NR	µg/L	EPA 625	Boron	0.2	mg/L	EPA 200.7	1	
2,4-Dichlorophenol	NR	µg/L	EPA 625	n-butylbenzene	<0.5	µg/L	EPA 524.2	260	
2,4-Dimethylphenol	NR	µg/L	EPA 625	sec-butylbenzene	<0.5	µg/L	EPA 524.2	260	
2-Methyl-4,6-dinitrophenol	NR	µg/L	EPA 625	tert-butylbenzene	<0.5	µg/L	EPA 524.2	260	
2,4-Dinitrophenol	NR	µg/L	EPA 625	Carbon disulfide	<0.5	µg/L	EPA 524.2	160	
2-Nitrophenol	NR	µg/L	EPA 625	Chlorate* (RW Blend /DCZ-LYS-25)	280 / <10	µg/L	EPA 300.0	800	
4-Nitrophenol	NR	µg/L	EPA 625	2-Chlorotoluene	<0.5	µg/L	EPA 524.2	140	
4-Chloro-3-methylphenol	NR	µg/L	EPA 625	4-Chlorotoluene	<0.5	µg/L	EPA 524.2	140	
Phenol	NR	µg/L	EPA 625	Diazinon	<0.5	µg/L	EPA 525.2	1.2	
2,4,6-Trichlorophenol	NR	µg/L	EPA 625	Dichlorodifluoromethane (Freon 12)	<0.5	µg/L	EPA 524.2	1000	
Base/Neutral Extractibles				1,4 - Dioxane	0.3	µg/L	EPA 522	1	
Acenaphthene	NR	µg/L	EPA 625	Ethylene glycol	<10	mg/L	EPA 8015B	14	
Acenaphthylene	NR	µg/L	EPA 625	Formaldehyde	47	µg/L	EPA 556	100	
Anthracene	NR	µg/L	EPA 625	HMX	<10	µg/L	EPA 8330B	350	
Benzidine	NR	µg/L	EPA 625	Isopropylbenzene	<0.5	µg/L	EPA 524.2	770	
Benzo(a)anthracene	NR	µg/L	EPA 625	Manganese	9	µg/L	EPA 200.8	500	
Benzo(b)fluoranthene	NR	µg/L	EPA 625	Methyl isobutyl ketone (MIBK)	<2	µg/L	EPA 524.2	120	
Benzo(g,h,i)perylene	NR	µg/L	EPA 625	Naphthalene	<0.5	µg/L	EPA 525.2/524.2	17	
Benzo(k)fluoranthene	NR	µg/L	EPA 625	N-Nitrosodiethylamine (NDEA)	<2	ng/L	EPA 521	10	
Bis(2-chloroethoxy)methane	NR	µg/L	EPA 625	N-Nitrosodimethylamine (NDMA)	<2	ng/L	EPA 521	10	
Bis(2-chloroethyl)ether	NR	µg/L	EPA 625	N-Nitrosodi-n-propylamine (NDPA)	<2	ng/L	EPA 521	10	
Bis(2-chloroisopropyl)ether	NR	µg/L	EPA 625	Propachlor	<4	µg/L	EPA 525.2	90	
4-Bromophenyl phenyl ether	NR	µg/L	EPA 625	N-propylbenzene	<0.5	µg/L	EPA 524.2	200	
Butyl benzyl phthalate	NR	µg/L	EPA 625	RDX	<20	µg/L	EPA 524.4	200	
2-Chloronaphthalene	NR	µg/L	EPA 625	Tertiary butyl alcohol	<2	µg/L	EPA 524.2	12	
4-Chlorophenyl phenyl ether	NR	µg/L	EPA 625	1,2,4-trimethylbenzene	<0.5	µg/L	EPA 524.2	330	
Chrysene	NR	µg/L	EPA 625	1,3,5-trimethylbenzene	<0.5	µg/L	EPA 524.2	330	
Dibenzo(a,h)anthracene	NR	µg/L	EPA 625	2,4,6-Trinitrotoluene	<10	µg/L	EPA 8330B	1	
1,3-Dichlorobenzene	NR	µg/L	EPA 625	Vanadium	<5	µg/L	EPA 200.8	50	
3,3-Dichlorobenzidine	NR	µg/L	EPA 625	Health-based and performance indicator CECs for Surface Application				RP3-1/1	
Diethyl phthalate	NR	µg/L	EPA 625	1,4 - Dioxane	0.3	µg/L	EPA 522	0.2	
Dimethyl phthalate	NR	µg/L	EPA 625	N-nitrosodimethylamine (NDMA)	<2	ng/L	EPA 521	<2	
Di-n-butyl phthalate	NR	µg/L	EPA 625	N-Nitrosomorphine	4.8	ng/L	EPA 521	<2	
2,4-Dinitrotoluene	NR	µg/L	EPA 625	Perfluorooctanesulfonic acid (PFOS)	5.3	ng/L	EPA 537.1	6.0	
2,6-Dinitrotoluene	NR	µg/L	EPA 625	Perfluorooctanoic acid (PFOA)	<2	ng/L	EPA 537.1	5.3	
Di-n-octyl phthalate	NR	µg/L	EPA 625	Gemfibrozil	<4	ng/L	LC-MS-MS	<4	
Azobenzene	NR	µg/L	EPA 625	Iohexol	24000	ng/L	LC-MS-MS	100	
Fluoranthene	NR	µg/L	EPA 625	Sucralose	98000	ng/L	LC-MS-MS	37000	
Fluorene	NR	µg/L	EPA 625	Sulfamethoxazole	<4	ng/L	LC-MS-MS	28	
Hexachlorobutadiene	NR	µg/L	EPA 625	ER-α (RW Blend / RP3-1/1)	NA	ng/L	Trussell Tech	NA	
Hexachlorocyclopentadiene	NR	µg/L	EPA 625	AhR (method pending approval)	--	ng/L	Trussell Tech	--	
Hexachloroethane	NR	µg/L	EPA 625	Bold & yellow highlight signifies an exceedance of a limit					
Indeno(1,2,3-cd)pyrene	NR	µg/L	EPA 625	NA: Not available from contract lab at time of reporting					
Isophorone	NR	µg/L	EPA 625						
Naphthalene	NR	µg/L	EPA 625						
Nitrobenzene	NR	µg/L	EPA 625						
N-Nitroso-di-n-propylamine	NR	µg/L	EPA 625						
N-Nitrosodiphenylamine	NR	µg/L	EPA 625						
Phenanthrene	NR	µg/L	EPA 625						
Pyrene	NR	µg/L	EPA 625						

NR: Not Required (Annual Requirement, Phase II FOF, Attachment A, Page 26, Item 19)

*Pursuant to the GRRP regulations, recharge water may be monitored at a monitoring well or lysimeter in lieu of recycled water for DDW-specified chemicals having notification levels.

**PFOA is being analyzed weekly for the exceedance of the NL and is reported in Section 2A of this report

Table 2-5
Alternative Monitoring Plans: TOC & TN

Date	RW Blend*					Banana					Hickory					
	mg/L=>	TOC	TOC-20 wk avg	TOC-4 sample avg	TN	TN - 2 sample avg.	TOC (93% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (47% reduction)	TN - 2 sample avg.	TOC (93% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (27% reduction)	TN - 2 sample avg.
	Limit ==>					10 mg/L (DDW)	16 mg/L (RWQCB)	Oct - Dec 2024 : 1.5; 1.6; 1.5 mg/L		5 mg/L (RWQCB)	16 mg/L (RWQCB)	Oct - Dec 2024 : 3.3; 3.4; 3.3 mg/L		5 mg/L (RWQCB)		
09/30/24	5.50	6.36	5.78	5.0	5.1	0.39	0.45	0.40	2.7	2.7	0.39	0.45	0.40	3.7	3.8	
10/03/24				4.8	4.9				2.5	2.6				3.5	3.6	
10/07/24	5.70	6.30	5.72	4.8	4.8	0.40	0.44	0.40	2.5	2.5	0.40	0.44	0.40	3.5	3.5	
10/10/24				4.7	4.8				2.5	2.5				3.5	3.5	
10/14/24	5.70	6.25	5.68	5.0	4.9	0.40	0.44	0.40	2.7	2.6	0.40	0.44	0.40	3.7	3.6	
10/17/24				4.3	4.7				2.3	2.5				3.1	3.4	
10/21/24	6.10	6.21	5.75	4.2	4.3	0.43	0.43	0.40	2.2	2.3	0.43	0.43	0.40	3.1	3.1	
10/24/24				4.7	4.5				2.5	2.4				3.4	3.3	
10/28/24	6.10	6.18	5.90	4.3	4.5	0.43	0.43	0.41	2.3	2.4	0.43	0.43	0.41	3.1	3.3	
10/31/24				5.4	4.8				2.9	2.6				3.9	3.5	
11/04/24	6.27	6.16	6.04	5.4	5.4	0.44	0.43	0.42	2.9	2.9	0.44	0.43	0.42	4.0	3.9	
11/07/24				5.2	5.3				2.7	2.8				3.8	3.9	
11/12/24	6.30	6.14	6.19	5.3	5.2	0.44	0.43	0.43	2.8	2.8	0.44	0.43	0.43	3.9	3.8	
11/13/24	6.20	6.10	6.22	3.5	4.4	0.43	0.43	0.44	1.9	2.3	0.43	0.43	0.44	2.6	3.2	
11/14/24				5.3	4.4				2.8	2.3				3.9	3.2	
11/15/24	6.30	6.10	6.27	5.7	5.5	0.44	0.43	0.44	3.0	2.9	0.44	0.43	0.44	4.2	4.0	
11/18/24	6.33	6.11	6.28	4.7	5.2	0.44	0.43	0.44	2.5	2.8	0.44	0.43	0.44	3.4	3.8	
11/21/24	6.50	6.11	6.33	5.2	4.9	0.46	0.43	0.44	2.7	2.6	0.46	0.43	0.44	3.8	3.6	
11/25/24	6.40	6.10	6.38	5.6	5.4	0.45	0.43	0.45	2.9	2.8	0.45	0.43	0.45	4.1	3.9	
11/28/24				5.1	5.3				2.7	2.8				3.7	3.9	
12/02/24	7.03	6.12	6.57	5.9	5.5	0.49	0.43	0.46	3.1	2.9	0.49	0.43	0.46	4.3	4.0	
12/05/24				5.4	5.7				2.9	3.0				4.0	4.1	
12/09/24	6.77	6.16	6.68	5.6	5.5	0.47	0.43	0.47	3.0	2.9	0.47	0.43	0.47	4.1	4.0	
12/12/24				5.5	5.5				2.9	2.9				4.0	4.1	
12/16/24	6.67	6.19	6.72	6.0	5.7	0.47	0.43	0.47	3.2	3.0	0.47	0.43	0.47	4.3	4.2	
12/19/24				5.9	5.9				3.1	3.1				4.3	4.3	
12/23/24	6.87	6.22	6.84	5.5	5.7	0.48	0.44	0.48	2.9	3.0	0.48	0.44	0.48	4.0	4.2	
12/25/24	5.93	6.21	6.56	4.9	5.2	0.42	0.43	0.46	2.6	2.8	0.42	0.43	0.46	3.6	3.8	
12/30/24	6.80	6.26	6.57	5.1	5.0	0.48	0.44	0.46	2.7	2.7	0.48	0.44	0.46	3.7	3.7	

*The RW blend of RP-1 & RP-4 effluent is sampled at the RP-4 1299 Pump Station. The TOC & TN values are used for the % reduction calculation of most of the GWR basins with the exception of the Ely Basins, which receives 001B Effluent.

Date	Turner 1 & 2					Turner 3 & 4					RP3					
	mg/L=>	TOC (70% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (87% reduction)	TN - 2 sample avg.	TOC (85% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (87% reduction)		TOC (88% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (31% reduction)	TN - 2 sample avg.
	Limit ==>	16 mg/L (RWQCB)	Oct - Dec 2024 : 2.3; 2.2; 2.2 mg/L			5 mg/L (RWQCB)	16 mg/L (RWQCB)	Oct - Dec 2024 : 2.3; 2.3; 2.1 mg/L		5 mg/L (RWQCB)	16 mg/L (RWQCB)	Oct - Dec 2024 : 1.8; 1.8; 1.8 mg/L		5 mg/L (RWQCB)		
09/30/24	1.65	1.91	1.73	0.7	0.7	0.83	0.95	0.87	0.7	0.7	0.66	0.76	0.69	3.5	3.5	
10/03/24				0.6	0.6				0.6	0.6				3.3	3.4	
10/07/24	1.71	1.89	1.72	0.6	0.6	0.86	0.94	0.86	0.6	0.6	0.68	0.76	0.69	3.3	3.3	
10/10/24				0.6	0.6				0.6	0.6				3.3	3.3	
10/14/24	1.71	1.88	1.70	0.7	0.6	0.86	0.94	0.85	0.7	0.6	0.68	0.75	0.68	3.5	3.4	
10/17/24				0.6	0.6				0.6	0.6				3.0	3.2	
10/21/24	1.83	1.86	1.73	0.6	0.6	0.92	0.93	0.86	0.6	0.6	0.73	0.75	0.69	2.9	2.9	
10/24/24				0.6	0.6				0.6	0.6				3.2	3.1	
10/28/24	1.83	1.85	1.77	0.6	0.6	0.92	0.93	0.89	0.6	0.6	0.73	0.74	0.71	2.9	3.1	
10/31/24				0.7	0.6				0.7	0.6				3.7	3.3	
11/04/24	1.88	1.85	1.81	0.7	0.7	0.94	0.92	0.91	0.7	0.7	0.75	0.74	0.73	3.7	3.7	
11/07/24				0.7	0.7				0.7	0.7				3.6	3.7	
11/12/24	1.89	1.84	1.86	0.7	0.7	0.95	0.92	0.93	0.7	0.7	0.76	0.74	0.74	3.6	3.6	
11/13/24	1.86	1.83	1.87	0.5	0.6	0.93	0.92	0.93	0.5	0.6	0.74	0.73	0.75	2.4	3.0	
11/14/24				0.7	0.6				0.7	0.6				3.7	3.1	
11/15/24	1.89	1.83	1.88	0.7	0.7	0.95	0.91	0.94	0.7	0.7	0.76	0.73	0.75	3.9	3.8	
11/18/24	1.90	1.83	1.88	0.6	0.7	0.95	0.92	0.94	0.6	0.7	0.76	0.73	0.75	3.3	3.6	
11/21/24	1.95	1.83	1.90	0.7	0.6	0.98	0.92	0.95	0.7	0.6	0.78	0.73	0.76	3.6	3.4	
11/25/24	1.92	1.83	1.91	0.7	0.7	0.96	0.92	0.96	0.7	0.7	0.77	0.73	0.77	3.8	3.7	
11/28/24				0.7	0.7				0.7	0.7				3.5	3.7	
12/02/24	2.11	1.84	1.97	0.8	0.7	1.05	0.92	0.98	0.8	0.7	0.84	0.73	0.79	4.1	3.8	
12/05/24				0.7	0.7				0.7	0.7				3.7	3.9	
12/09/24	2.03	1.85	2.00	0.7	0.7	1.02	0.92	1.00	0.7	0.7	0.81	0.74	0.80	3.9	3.8	
12/12/24				0.7	0.7				0.7	0.7				3.8	3.8	
12/16/24	2.00	1.86	2.02	0.8	0.7	1.00	0.93	1.01	0.8	0.7	0.80	0.74	0.81	4.1	4.0	
12/19/24				0.8	0.8				0.8	0.8				4.1	4.1	
12/23/24	2.06	1.86	2.05	0.7	0.7	1.03	0.93	1.03	0.7	0.7	0.82	0.75	0.82	3.8	3.9	
12/25/24	1.78	1.86	1.97	0.6	0.7	0.89	0.93	0.98	0.6	0.7	0.71	0.75	0.79	3.4	3.6	
12/30/24	2.04	1.88	1.97	0.7	0.7	1.02	0.94	0.99	0.7	0.7	0.82	0.75	0.79	3.5	3.5	

Table 2-5
Alternative Monitoring Plans: TOC & TN

Date	8th Street					Victoria					San Sevaire 1-3						
	mg/L=>	TOC (93% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (75% reduction)	TN - 2 sample avg.	TOC (91% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (82% reduction)	TN - 2 sample avg.	TOC (92% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (34% reduction)	TN - 2 sample avg.	
	Limit ==>	16 mg/L (RWQCB)	Oct - Dec 2024 : 2.3; 2.3; 2.2 mg/L			5 mg/L (RWQCB)		16 mg/L (RWQCB)	Oct - Dec 2024 : 2.0; 2.0; 2.0 mg/L			5 mg/L (RWQCB)		16 mg/L (RWQCB)	Oct - Dec 2024 : 3.1; 3.1; 3.1 mg/L		
09/30/24	0.39	0.45	0.40	1.3	1.3	0.50	0.57	0.52	1.3	1.3	0.44	0.51	0.46	3.3	3.4		
10/03/24				1.2	1.2				1.2	1.2				3.2	3.2		
10/07/24	0.40	0.44	0.40	1.2	1.2	0.51	0.57	0.51	1.2	1.2	0.46	0.50	0.46	3.2	3.2		
10/10/24				1.2	1.2				1.2	1.2				3.1	3.1		
10/14/24	0.40	0.44	0.40	1.3	1.2	0.51	0.56	0.51	1.3	1.2	0.46	0.50	0.45	3.3	3.2		
10/17/24				1.1	1.2				1.1	1.2				2.8	3.1		
10/21/24	0.43	0.43	0.40	1.1	1.1	0.55	0.56	0.52	1.1	1.1	0.49	0.50	0.46	2.8	2.8		
10/24/24				1.2	1.1				1.2	1.1				3.1	2.9		
10/28/24	0.43	0.43	0.41	1.1	1.1	0.55	0.56	0.53	1.1	1.1	0.49	0.49	0.47	2.8	3.0		
10/31/24				1.3	1.2				1.3	1.2				3.6	3.2		
11/04/24	0.44	0.43	0.42	1.4	1.4	0.56	0.55	0.54	1.4	1.4	0.50	0.49	0.48	3.6	3.6		
11/07/24				1.3	1.3				1.3	1.3				3.4	3.5		
11/12/24	0.44	0.43	0.43	1.3	1.3	0.57	0.55	0.56	1.3	1.3	0.50	0.49	0.50	3.5	3.5		
11/13/24	0.43	0.43	0.44	0.9	1.1	0.56	0.55	0.56	0.9	1.1	0.50	0.49	0.50	2.3	2.9		
11/14/24				1.3	1.1				1.3	1.1				3.5	2.9		
11/15/24	0.44	0.43	0.44	1.4	1.4	0.57	0.55	0.56	1.4	1.4	0.50	0.49	0.50	3.8	3.6		
11/18/24	0.44	0.43	0.44	1.2	1.3	0.57	0.55	0.57	1.2	1.3	0.51	0.49	0.50	3.1	3.4		
11/21/24	0.46	0.43	0.44	1.3	1.2	0.59	0.55	0.57	1.3	1.2	0.52	0.49	0.51	3.4	3.3		
11/25/24	0.45	0.43	0.45	1.4	1.3	0.58	0.55	0.57	1.4	1.3	0.51	0.49	0.51	3.7	3.5		
11/28/24				1.3	1.3				1.3	1.3				3.4	3.5		
12/02/24	0.49	0.43	0.46	1.5	1.4	0.63	0.55	0.59	1.5	1.4	0.56	0.49	0.53	3.9	3.7		
12/05/24				1.4	1.4				1.4	1.4				3.6	3.7		
12/09/24	0.47	0.43	0.47	1.4	1.4	0.61	0.55	0.60	1.4	1.4	0.54	0.49	0.53	3.7	3.6		
12/12/24				1.4	1.4				1.4	1.4				3.6	3.7		
12/16/24	0.47	0.43	0.47	1.5	1.4	0.60	0.56	0.60	1.5	1.4	0.53	0.50	0.54	3.9	3.8		
12/19/24				1.5	1.5				1.5	1.5				3.9	3.9		
12/23/24	0.48	0.44	0.48	1.4	1.4	0.62	0.56	0.62	1.4	1.4	0.55	0.50	0.55	3.7	3.8		
12/25/24	0.42	0.43	0.46	1.2	1.3	0.53	0.56	0.59	1.2	1.3	0.47	0.50	0.52	3.2	3.5		
12/30/24	0.48	0.44	0.46	1.3	1.3	0.61	0.56	0.59	1.3	1.3	0.54	0.50	0.53	3.4	3.3		

Date	Declez					Brooks					
	mg/L=>	TOC (62% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (91% reduction)	TN - 2 sample avg.	TOC (92% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (83% reduction)*	TN - 2 sample avg.
	Limit ==>	16 mg/L (RWQCB)	Oct - Dec 2024 : 7.8; 7.6; 7.5 mg/L			5 mg/L (RWQCB)		16 mg/L (RWQCB)	Oct - Dec 2024 : 4.2; 4.2; 4.2 mg/L		
09/30/24	2.09	2.42	2.19	0.5	0.5	0.44	0.51	0.46	0.9	0.9	
10/03/24				0.4	0.4				0.8	0.8	
10/07/24	2.17	2.39	2.17	0.4	0.4	0.46	0.50	0.46	0.8	0.8	
10/10/24				0.4	0.4				0.8	0.8	
10/14/24	2.17	2.38	2.16	0.5	0.4	0.46	0.50	0.45	0.9	0.8	
10/17/24				0.4	0.4				0.7	0.8	
10/21/24	2.32	2.36	2.19	0.4	0.4	0.49	0.50	0.46	0.7	0.7	
10/24/24				0.4	0.4				0.8	0.8	
10/28/24	2.32	2.35	2.24	0.4	0.4	0.49	0.49	0.47	0.7	0.8	
10/31/24				0.5	0.4				0.9	0.8	
11/04/24	2.38	2.34	2.30	0.5	0.5	0.50	0.49	0.48	0.9	0.9	
11/07/24				0.5	0.5				0.9	0.9	
11/12/24	2.39	2.33	2.35	0.5	0.5	0.50	0.49	0.50	0.9	0.9	
11/13/24	2.36	2.32	2.36	0.3	0.4	0.50	0.49	0.50	0.6	0.7	
11/14/24				0.5	0.4				0.9	0.8	
11/15/24	2.39	2.32	2.38	0.5	0.5	0.50	0.49	0.50	1.0	0.9	
11/18/24	2.41	2.32	2.39	0.4	0.5	0.51	0.49	0.50	0.8	0.9	
11/21/24	2.47	2.32	2.41	0.5	0.4	0.52	0.49	0.51	0.9	0.8	
11/25/24	2.43	2.32	2.43	0.5	0.5	0.51	0.49	0.51	0.9	0.9	
11/28/24				0.5	0.5				0.9	0.9	
12/02/24	2.67	2.33	2.49	0.5	0.5	0.56	0.49	0.53	1.0	0.9	
12/05/24				0.5	0.5				0.9	1.0	
12/09/24	2.57	2.34	2.54	0.5	0.5	0.54	0.49	0.53	0.9	0.9	
12/12/24				0.5	0.5				0.9	0.9	
12/16/24	2.53	2.35	2.55	0.5	0.5	0.53	0.50	0.54	1.0	1.0	
12/19/24				0.5	0.5				1.0	1.0	
12/23/24	2.61	2.36	2.60	0.5	0.5	0.55	0.50	0.55	0.9	1.0	
12/25/24	2.25	2.36	2.49	0.4	0.5	0.47	0.50	0.52	0.8	0.9	
12/30/24	2.58	2.38	2.50	0.5	0.5	0.54	0.50	0.53	0.9	0.9	

Table 2-5
Alternative Monitoring Plans: TOC & TN

Date	001B Effluent *					Ely 3 East (001B Effluent)*					
	mg/L==>	TOC	TOC-20 wk avg	TOC-4 sample avg	TN	TN - 2 sample avg.	TOC (86% reduction)	TOC-20 wk avg	TOC-4 sample avg	TN (52% reduction)	TN - 2 sample avg.
	Limit ==>					10 mg/L (DDW)	16 mg/L (RWQCB)	Oct - Dec 2024 : 2.7; 2.7; 2.6 mg/L		5 mg/L (RWQCB)	
09/30/24	6.43				5.1	4.9	1.54			2.4	2.3
10/03/24	6.00	6.88	6.18		4.1	4.6	0.84	0.96	0.87	1.9	2.2
10/07/24	5.87				4.8	4.4	0.82			2.3	2.1
10/10/24	6.03	6.81	5.98		4.7	4.7	0.84	0.95	0.84	2.2	2.3
10/14/24	5.90				5.2	4.9	0.83			2.5	2.4
10/17/24	6.03	6.75	6.09		4.4	4.8	0.84	0.94	0.85	2.1	2.3
10/21/24	6.50				4.4	4.4	0.91			2.1	2.1
10/24/24	6.17	6.70	6.32		4.5	4.5	0.86	0.94	0.89	2.2	2.1
10/28/24	6.30				5.2	4.9	0.88			2.5	2.3
10/31/24	6.70	6.66	6.37		5.4	5.3	0.94	0.93	0.89	2.6	2.5
11/04/24	6.57				5.7	5.5	0.92			2.8	2.7
11/07/24	6.27	6.61	6.44		5.0	5.4	0.88	0.93	0.90	2.4	2.6
11/12/24	6.77				5.7	5.4	0.95			2.7	2.6
11/14/24	6.83	6.59	6.62		5.2	5.4	0.96	0.92	0.93	2.5	2.6
11/15/24	6.67				5.4	5.3	0.93			2.6	2.5
11/18/24	7.23	6.59	7.01		5.2	5.3	1.01	0.92	0.98	2.5	2.5
11/21/24	7.10				4.8	5.0	0.99			2.3	2.4
11/25/24	7.10	6.59	7.43		6.0	5.4	0.99	0.92	1.04	2.9	2.6
11/27/24	8.00				5.9	6.0	1.12			2.8	2.9
12/02/24	7.27	6.61	7.38		6.5	6.2	1.02	0.93	1.03	3.1	3.0
12/05/24	7.33				5.6	6.1	1.03			2.7	2.9
12/09/24	7.20	6.63	7.12		5.7	5.7	1.01	0.93	1.00	2.7	2.7
12/12/24	7.10				5.6	5.6	0.99			2.7	2.7
12/16/24	7.00	6.65	7.19		5.6	5.6	0.98	0.93	1.01	2.7	2.7
12/19/24	7.23				6.6	6.1	1.01			3.2	2.9
12/23/24	7.47	6.67	7.13		4.9	5.8	1.05	0.93	1.00	2.4	2.8
12/26/24	6.54				5.5	5.2	0.92			2.6	2.5
12/30/24	6.97				5.3	5.4	0.98			2.5	2.6

* 001B Effluent is RP-1 Recycled water that is delivered to the Ely Basins.

Title 22 §60320.118(c) Analytical results of the TOC monitoring performed pursuant to subsection (a) shall not exceed 0.5 mg/L divided by the RMA RWC based on: (1) the 20-week running average of all TOC results; and (2) the average of the last four TOC results." TOCavg limits are calculated and can be found in Table 2-6.

Table 2-6
RWC, TOC Average, and TN Compliance Summary

Basin	SUP Start Date	SUP End Date	SUP Report Submittal	RWC Limit (120-MRA)	Mos. in Operation (Dec 2024)	Month	RWC _{Avg} (120-MRA)	TOC _{Avg} Limit* (mg/L)	Max TOC _{Avg} (20-wk avg)	Max TOC _{Avg} in mg/L (20-wk avg) Compliance	Max TOC _{Avg} in mg/L (4-sample avg)	Max TOC _{Avg} (4-sample avg) Compliance	Max TN in mg/L (2-sample avg)	TN 10 mg/L DDW Limit** Compliance	Recharged Water Monitoring Plan
7 th & 8 th Street	Sep-07	Dec-10	05/23/11	50%	208	Oct-24	21%	2.3	0.4	Met	0.4	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 93% (based on 10-year average reduction from 2014 to 2023 at 8TH-1/1) and TN reduction of 75%
						Nov-24	22%	2.3	0.4	Met	0.4	Met	5.5	Met	
						Dec-24	22%	2.2	0.4	Met	0.5	Met	5.9	Met	
Banana	Jul-05	Jan-06	10/27/06	50%	234	Oct-24	33%	1.5	0.4	Met	0.4	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 93% (based on 10-year average reduction from 2014 to 2023 at BH-1/2) and TN reduction of 47%
						Nov-24	32%	1.6	0.4	Met	0.4	Met	5.5	Met	
						Dec-24	32%	1.5	0.4	Met	0.5	Met	5.9	Met	
Brooks	Aug-08	Dec-09	07/29/10	50%	197	Oct-24	12%	4.2	0.5	Met	0.5	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 92% (based on 10-year average reduction from 2014 to 2023 at BRK-1/1) and TN reduction of 83%.
						Nov-24	12%	4.2	0.5	Met	0.5	Met	5.5	Met	
						Dec-24	12%	4.2	0.5	Met	0.5	Met	5.9	Met	
Declez	Dec-15	Sep-16	05/21/18	initial 20%	109	Oct-24	6%	7.8	2.4	Met	2.2	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 62% and TN reduction of 91%
						Nov-24	7%	7.6	2.3	Met	2.4	Met	5.5	Met	
						Dec-24	7%	7.5	2.4	Met	2.6	Met	5.9	Met	
Ely***	RW initiated Sep-99	NA	NA	50%	304	Oct-24	18%	2.7	1.0	Met	0.9	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RP-1 RW sample with TOC reduction of 86% (based on 10-year average reduction from 2009 to 2018 at Ely MW1) and TN reduction of 52%
						Nov-24	19%	2.7	0.9	Met	1.0	Met	5.5	Met	
						Dec-24	19%	2.6	0.9	Met	1.0	Met	6.2	Met	
Hickory	Sep-05	Feb-06	02/15/07	50%	232	Oct-24	15%	3.3	0.4	Met	0.4	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 93% (based on 10-year average reduction from 2014 to 2023 at BH-1/2) and TN reduction of 27%
						Nov-24	15%	3.4	0.4	Met	0.4	Met	5.5	Met	
						Dec-24	15%	3.3	0.4	Met	0.5	Met	5.9	Met	
RP3	Jun-09	Jun-10	12/15/10	50%	187	Oct-24	28%	1.8	0.8	Met	0.7	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 88% and TN reduction of 31%
						Nov-24	28%	1.8	0.7	Met	0.8	Met	5.5	Met	
						Dec-24	28%	1.8	0.8	Met	0.8	Met	5.9	Met	
San Sevaine 1-3	Aug-20	Sep-21	02/08/22	50%	53	Oct-24	16%	3.1	0.5	Met	0.5	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 92% and TN reduction of 34%
						Nov-24	16%	3.1	0.5	Met	0.5	Met	5.5	Met	
						Dec-24	16%	3.1	0.5	Met	0.5	Met	5.9	Met	
Turner 1&2	Dec-06	May-07	07/03/08	24%	217	Oct-24	22%	2.3	1.9	Met	1.8	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 70%; TN reduction of 87%
						Nov-24	22%	2.2	1.8	Met	1.9	Met	5.5	Met	
						Dec-24	23%	2.2	1.9	Met	2.1	Met	5.9	Met	
Turner 3&4	Dec-06	May-07	07/03/08	45%	217	Oct-24	22%	2.3	0.9	Met	0.9	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 85% ; TN reduction of 87%
						Nov-24	22%	2.3	0.9	Met	1.0	Met	5.5	Met	
						Dec-24	23%	2.1	0.9	Met	1.0	Met	5.9	Met	
Victoria	Sep-10	Jul-11	02/08/12	50%	172	Oct-24	25%	2.0	0.6	Met	0.5	Met	4.9	Met	Alternative monitoring: <u>Weekly</u> RW Blend with TOC reduction of 91% (based on 10-year average reduction from 2014 to 2023 at VCT-1/1) and TN reduction of 82%
						Nov-24	25%	2.0	0.6	Met	0.6	Met	5.5	Met	
						Dec-24	25%	2.0	0.6	Met	0.6	Met	5.9	Met	

SUP - Start-Up Period 120-MRA - The recycled water contribution (RWC) limit and the RWC avg are based on 120-month running average

TOC 20-week average and 4-sample averages are pursuant to Title 22 §60320.118(c): "Analytical results of the TOC monitoring performed pursuant to subsection (a) shall not exceed 0.5 mg/L divided by the RMA RWC"

*TOC_{Avg} limit is 0.5 mg/L divided by the RWC_{Avg}. Compliance is determined by checking that monthly TOC_{Avg} does not exceed the TOC_{Avg} limit. If the TOC_{Avg} limit is exceeded, the monthly TOC_{Avg} will be bolded.

**TN limit is 10 mg/L based on a two-sample average of the RW Blend and 001B Effluent.

***Ely Basin receives 001B Effluent, which is RP-1 effluent only. All other basins receive RW Blend, which is a blend of RP-1 & RP-4 recycled water.

Table 2-7a
Diluent Water Monitoring*: Local Runoff/ Stormwater

Constituent	Local Runoff	Local Runoff	Local Runoff	Local Runoff	Max Level to Trigger Source Water Evaluation	Unit	Method
	Cucamonga Creek @ Turner 1&2 12/16/24	Deer Creek @ Turner 3&4 12/16/24	San Antonio Creek @ Montclair 12/18/24	W Cuca Creek @ Ely 12/18/24			
NO ₂ -N	<0.05	<0.05	<0.05	0.07	1	mg/L	EPA 300.0
NO ₃ -N	0.6	<0.1	2.3	0.1	10	mg/L	EPA 300.0
TDS	272	264	232	152	1000	mg/L	SM 2540C
Total Coliform	110	430	350	170	-	mpn/100ml	SM 9221B
Oil & Grease	1.5	<1	5.2	2.2	-	mg/L	EPA 1664A
Inorganic Chemicals							
Aluminum	<25	30	132	78	1000	µg/L	EPA 200.7
Antimony	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic	<2	<2	<2	<2	10	µg/L	EPA 200.8
Asbestos	<0.2	<1	<1	<1	7	MFL	EPA 100.2
Barium	35	43	44	23	1000	µg/L	EPA 200.7
Beryllium	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.7
Cadmium	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.7
Chromium	<2	<2	3.7	<2	50	µg/L	EPA 200.7
Chromium VI	1.6	2.2	0.4	2.6	10	µg/L	EPA 218.6
Cyanide	<20	<20	<20	<20	150	µg/L	ASTM D7284/OIA-1677
Fluoride	0.3	0.3	0.1	0.3	2	mg/L	SM 4500-F C
Mercury	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.2
Nickel	3	2	2	2	100	µg/L	EPA 200.7
Perchlorate	2	1	<2	2	6	µg/L	EPA 314
Selenium	<2	<2	<2	<2	50	µg/L	EPA 200.8
Thallium	<1	<1	<1	<1	2	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)							
Benzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Chlorobenzene	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl Tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Total Xylenes	<0.5	<0.5	<0.5	<0.5	1750	µg/L	EPA 524.2
1,2,3-Trichloropropane	<0.005	<0.005	<0.005	<0.005	0.005	µg/L	CASRL 524M-TCP
Non-Volatile Synthetic Organic Chemicals (SOCs)							
Alachlor (Alanex)	<2	<0.1	<1	<2	2	µg/L	EPA 505/508.1
Atrazine	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<0.1	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<20	<5	<2	<2	18	µg/L	EPA 531.2
Chlordane	<1	<1	<0.5	<1	0.1	µg/L	EPA 505/508.1
2,4-D	<0.4	<0.5	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	<0.4	<5	<0.4	<0.4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<2	<0.01	<0.01	0.2	µg/L	EPA 504.1/EPA 524.3
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<2	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	<10	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.1	<0.1	<0.05	<0.1	2	µg/L	EPA 505/508.1
Ethylene Dibromide	<0.02	<2	<0.02	<0.02	0.05	µg/L	EPA 504.1
Glyphosate	<25	<2	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.1	<0.1	<0.05	<0.1	0.01	µg/L	EPA 505/508.1
Heptachlor Epoxide	<0.1	<0.1	<0.05	<0.1	0.01	µg/L	EPA 505/508.1
Hexachlorobenzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2/EPA508.1
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2/EPA508.1
Lindane	<0.1	<0.1	<0.05	<0.1	0.2	µg/L	EPA 505/508.1
Methoxychlor	<0.1	<0.1	<0.05	<0.1	30	µg/L	EPA 505/508.1
Molinate	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2

Table 2-7a
Diluent Water Monitoring*: Local Runoff/ Stormwater

Constituent	Local Runoff	Local Runoff	Local Runoff	Local Runoff	Max Level to Trigger Source Water Evaluation	Unit	Method
	Cucamonga Creek @ Turner 1&2 12/16/24	Deer Creek @ Turner 3&4 12/16/24	San Antonio Creek @ Montclair 12/18/24	W Cuca Creek @ Ely 12/18/24			
Oxamyl	<20	<0.2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<10	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.1	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<5	<0.1	<0.5	<5	0.5	µg/L	EPA 505/508.1
PCB 1221	<5	<0.1	<0.5	<5	0.5	µg/L	EPA 505/508.1
PCB 1232	<5	<0.1	<0.5	<5	0.5	µg/L	EPA 505/508.1
PCB 1242	<5	<0.1	<0.5	<5	0.5	µg/L	EPA 505/508.1
PCB 1248	<5	<0.1	<0.5	<5	0.5	µg/L	EPA 505/508.1
PCB 1254	<5	<0.1	<0.5	<5	0.5	µg/L	EPA 505/508.1
PCB 1260	<5	<0.1	<0.5	<5	0.5	µg/L	EPA 505/508.1
Simazine	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<10	<10	<5	<10	3	µg/L	EPA 505/508.1
2,3,7,8-TCDD (Dioxin)	<50	<50	<5	<50	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.1	<0.2	<0.2	50	µg/L	EPA 515.4
Disinfection Byproducts							
Total Trihalomethanes (TTHMs)	<0.5	<0.5	<0.5	<0.5	80	µg/L	EPA 524.2/624
Total Haloacetic Acids (HAA5)	11	2	<2	7	60	µg/L	SM 6251B/EPA 552.3
Bromate	<0.005	<0.005	<0.005	<0.005	10	µg/L	EPA 300.1/317
Chlorite	<0.01	<0.01	<0.01	<0.01	1	mg/L	EPA 300.0
Action Level Chemicals							
Copper	6	4	<3	4	1300	µg/L	EPA 200.8
Lead	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides							
Combined Radium-226 & Radium 228	<3	<3	<3	<3	5	pCi/L	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	4	15	pCi/L	EPA 900.0/SM7110C
Tritium	<300	<300	<300	<300	20,000	pCi/L	EPA 906.0
Strontium-90	<3	<3	<3	<3	8	pCi/L	EPA 905.0
Gross Beta Particle Activity	5	4	3	1	50	pCi/L	EPA 900.0
Uranium	<1	<1	<1	<1	20	pCi/L	EPA 200.8
Chemicals w/ State Notification Levels							
Boron	<0.1	<0.1	<0.1	<0.1	1	mg/L	EPA 200.7
n-butylbenzene	<0.5	<0.5	<0.5	<0.5	260	µg/L	EPA 524.2
sec-butylbenzene	<0.5	<0.5	<0.5	<0.5	260	µg/L	EPA 524.2
tert-butylbenzene	<0.5	<0.5	<0.5	<0.5	260	µg/L	EPA 524.2
Carbon disulfide	<0.5	<0.5	<0.5	<0.5	160	µg/L	EPA 524.2
Chlorate	543	263	25	<10	800	µg/L	EPA 300.0
2-Chlorotoluene	<0.5	<0.5	<0.5	<0.5	140	µg/L	EPA 524.2
4-Chlorotoluene	<0.5	<0.5	<0.5	<0.5	140	µg/L	EPA 524.2
Diazinon	<0.5	<0.5	<0.5	<0.5	1.2	µg/L	EPA 525.2
Dichlorodifluoromethane (Freon 12)	<0.5	<0.5	<0.5	<0.5	1000	µg/L	EPA 524.2
1,4 - Dioxane	<0.015	<0.015	<0.015	<0.015	1	µg/L	EPA 522
Ethylene glycol	<40	<2	<10	<20	14	mg/L	EPA 8015B/504.1
Formaldehyde	14	8	11	7	100	µg/L	EPA 556
HMX	<10	<0.1	<5	<20	350	µg/L	EPA 8330B
Isopropylbenzene	<0.5	<0.5	<0.5	<0.5	770	µg/L	EPA 524.2
Manganese	2	2	15	4	500	µg/L	EPA 200.8
Methyl isobutyl ketone (MIBK)	<2	<2	<2	<2	120	µg/L	EPA 524.2
Naphthalene	<0.5	<0.5	<0.5	<0.5	17	µg/L	EPA 524.2
N-Nitrosodiethylamine (NDEA)	<2	<50	<2	<2	10	ng/L	EPA 521
N-nitrosodimethylamine (NDMA)	<2	<0.02	<2	<2	10	ng/L	EPA 521
N-Nitrosodi-n-propylamine (NDPA)	<2	<0.2	<2	<2	10	ng/L	EPA 521
PFOS	3.6	<2	2.6	3.6	4.0** / 5.1 (NL)	ng/L	EPA 537.1
PFOA	5.0	2.1	<2	6.4	4.0** / 5.1 (NL)	ng/L	EPA 537.1
Propachlor	<0.5	<0.5	<0.5	<0.5	90	µg/L	EPA 525.2
N-propylbenzene	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
RDX	<50	<2	<20	<20	0.3	µg/L	EPA 8330B
Tertiary butyl alcohol	<2	<2	<2	<2	12	µg/L	EPA 524.2
1,2,4 -trimethylbenzene	<0.5	<0.5	<0.5	<0.5	330	µg/L	EPA 524.2
1,3,5-trimethylbenzene	<0.5	<0.5	<0.5	<0.5	330	µg/L	EPA 524.2
2,4,6-Trinitrotoluene	<10	<10	<20	<5	1	µg/L	EPA 8330B
Vanadium	14	10	<5	6	50	µg/L	EPA 200.8

* Diluent monitoring is monitored per the schedule identified in the CDPH-approved Diluent Water Monitoring Plan

** New Federal MCL effective June 25, 2024 are italicized

NA: Not available at time of reporting

Bold & yellow highlight signifies an exceedance of the maximum level to trigger a source water evaluation.

Table 2-7b
Diluent Water Monitoring: State Water Project - Silverwood Lake

Constituent	Jan-24	Feb-24	Mar-24	Apr-24	May-24	Jun-24	Jul-24	Aug-24	Sep-24	Oct-24	Nov-24	Dec-24	Unit
Silica	12.0	11.5	11.8	10.9	10.9	10.4	9.9	9.7	10.6	10.8	10.4	11.2	mg/L
Calcium	21	20	20	21	22	21	19	17	14	14	15	16	mg/L
Magnesium	11	10	10	11	11	10	9	8	8	8	9	9	mg/L
Sodium	43	42	41	47	44	43	39	31	25	27	30	34	mg/L
Potassium	3.0	2.8	2.8	3.2	3.0	2.9	2.7	2.3	1.9	1.9	2.1	2.2	mg/L
Carbonate	0	0	0	0	0	0	0	0	0	0	0	0	mg/L
Bicarbonate	92	87	84	94	92	93	83	81	76	81	78	84	mg/L
Sulfate	34	29	28	34	35	38	34	26	16	13	16	19	mg/L
Chloride	58	54	55	61	58	54	48	38	33	35	41	44	mg/L
Nitrate	3.1	2.7	2.4	2.4	2.6	1.2	1.5	0.8	0.3	0.3	0.6	1.2	mg/L
Fluoride	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	mg/L
Total Dissolved Solids	231	216	213	238	233	227	205	174	147	151	163	179	mg/L
Total Hardness as CaCO ₃	97	91	89	99	99	98	90	82	66	68	76	78	mg/L
Total Alkalinity as CaCO ₃	75	71	69	77	75	76	68	66	62	66	64	69	mg/L
Free Carbon Dioxide	1.9	2.3	2.1	2.0	3.0	1.3	1.7	1.7	1.9	2.5	2.5	2.3	mg/L
pH	7.90	7.80	7.82	7.89	7.70	8.08	7.90	7.89	7.83	7.73	7.72	7.79	unit
Specific Conductance	407	382	378	430	417	399	374	316	277	275	306	329	µmho/cm
Color	10	--	--	15	--	--	10	--	--	5	--	--	CU
Turbidity	0.61	6.2	11.0	1.6	0.91	1.1	1.5	2.0	1.6	1.3	1.7	1.7	NTU
Temperature	11	9	10	12	13	19	25	26	24	22	17	12	°C
Bromide	0.17	0.17	0.17	0.19	0.18	0.17	0.14	0.11	0.10	0.11	0.13	0.14	mg/L
Total Organic Carbon	3.64	4.34	4.62	4.44	4.26	4.27	3.75	3.52	3.41	2.83	2.87	2.70	mg/L

Table 2-8
Summary of Wells in Groundwater Monitoring Networks

BASIN	CBWM_ID	OWNER/LOCAL NAME	SEPARATION DISTANCE (feet)	SCREENED INTERVAL(S) (feet bgs)	CASING DIAMETER (inches)	STATUS	TYPE
Hickory and Banana Basins	600490	Fontana Water Company - F7a***	3330 upgradient	590-1000	18	Active	Municipal
	--	Fontana Water Company - F7b*****	3100 upgradient	600-990	20	Active	Municipal
	600660	California Speedway - Infield Well	2070 downgradient	NA	NA	Active	Industrial
	3601365	California Speedway 2	2780 downgradient	451-455, 491-603, & 664-780	20	Active	Industrial
	601002	Inland Empire Utilities Agency - BH-1/2	340 downgradient	435-475	4	Active	Monitoring
Turner Basins	600453	City Of Ontario - 29	2810 downgradient	400-1095	18	Active	Municipal
	600585	City of Ontario - 38*	4600 crossgradient	500-1010	16	Active	Municipal
	600998	Inland Empire Utilities Agency - T-1/2	50 downgradient	380-400	4	Active	Monitoring
	601000	Inland Empire Utilities Agency - T-2/2	50 downgradient	392-412	4	Active	Monitoring
Decluz Basin	300208	Jurupa Community Services District - 19	8900 downgradient	230-390	18	Active	Municipal
	300207	Jurupa Community Services District - 17	5240 downgradient	259-290, & 300-400	NA	Active	Municipal
	300200	Jurupa Community Services District - 13	5730 downgradient	220-446	16-34	Active	Municipal
	300484	Inland Empire Utilities Agency - DCZ-1/1	50 downgradient	155-175	4	Active	Monitoring
	--	Inland Empire Utilities Agency - DCZ-2	4,100 downgradient	240-270	4	Active	Monitoring
RP-3 Basins	600492	Fontana Water Company - F23a	7900 upgradient	450-740	18	Active	Municipal
	600477	Inland Empire Utilities Agency - Southridge JHS	5500 downgradient	NA	NA	Active	Monitoring
	600848	Alcoa - Offsite MW1	9480 downgradient	NA	NA	Active	Monitoring
	600850	Alcoa - Offsite MW3	4725 downgradient	NA	NA	Active	Monitoring
	601040	Inland Empire Utilities Agency - RP3-1/1	100 downgradient	215-235	4	Active	Monitoring
Jurupa Basin	Not currently planned for recharge						
7th & 8th Street Basins	600493	City of Ontario No. 35	9695 downgradient	580-1020	18-36	Active	Municipal
	601036	Inland Empire Utilities Agency - 8TH-1/1	150 downgradient	495-535	4	Active	Monitoring
	601037	Inland Empire Utilities Agency - 8TH-1/2	150 downgradient	595-645	4	Active	Monitoring
	601038	Inland Empire Utilities Agency - 8TH-2/1	2460 downgradient	465-505	4	Active	Monitoring
	601039	Inland Empire Utilities Agency - 8TH-2/2	2460 downgradient	576-616	4	Active	Monitoring
Brooks Basins	1901719	City of Pomona P-10	1983 downgradient	295-784	20	Active	Municipal
	1904001	City of Pomona P-34	2550 downgradient	363-367,380-400, 419-427	20	Active	Municipal
	601050	Inland Empire Utilities Agency - BRK-1/1	144 downgradient	310-350	4	Active	Monitoring
	601051	Inland Empire Utilities Agency - BRK-1/2	144 downgradient	520-560	4	Active	Monitoring
	601048	Inland Empire Utilities Agency - BRK-2/1	1305 downgradient	320-360	4	Active	Monitoring
	601049	Inland Empire Utilities Agency - BRK-2/2	1305 downgradient	560-600	4	Active	Monitoring
San Sevaine Basins	600905	Cucamonga Valley Water District No. 39	8300-13170 downgradient	750-870, 940-960, 970-1060, & 1080-1130,	20	Active	Municipal
	601115	Inland Empire Utilities Agency - SS-1/1	~39-116 downgradient	640-680	4	Active	Monitoring
	--	Inland Empire Utilities Agency - SSV-2	200 downgradient	370-395	4	Active	Monitoring
	600462	Unitex 91090	~1601 downgradient	NA	NA	Active	Private Domestic
Victoria Basin	600905	Cucamonga Valley Water District No. 39	4329 downgradient	750-870, 940-960, 970-1060, & 1080-1130,	20	Active	Municipal
	601033	Cucamonga Valley Water District No. 43**	8300 downgradient	650-800	32-42	Active	Municipal
	601117	Inland Empire Utilities Agency - VCT-1/1	~39-116 downgradient	570-610	4	Active	Monitoring
	--	Inland Empire Utilities Agency - VCT-2/2	~ 2000 downgradient	570-610	4	Active	Monitoring
Ely Basin	--	Inland Empire Utilities Agency - Ely-3	100 downgradient	246-306	4	Active	Monitoring
	601004	Ely Basin MW-2, Walnut Well (Casing 2)	3050 downgradient	290 - 310	4	Active	Monitoring
	3600975	Riverside Drive Well (43840-CWW)	6046 downgradient	NA	NA	Active	Private Irrigation
	600134	Bishop Of San Bernardino Corp. - DOM	6500 downgradient	NA	NA	Active	Private Domestic

Notes:

NA = Data not available

CBWM ID = Chino Basin Water Master well identification number

bgs = below ground surface

* = Ontario Well No. 38 replaced Ontario Well No. 19, which is inactive

** = Cucamonga Valley Water District No. 43 replaced CVWD Well Nos. 35 & 36, which are inactive.

*** = Fontana Water Company Well 7A replaced Fontana Water Company Well 37A (1Q18)

**** = Inland Empire Utilities Agency Ely-3 replaced Ely Basin MW-1, P

***** = Fontana Water Company Well 7B sampled when Fontana Water Company Well 7A is out of service

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	8TH-1/1	8TH-1/2	8TH-2/1	8TH-2/2	MCL	Unit	Method
Inorganic Chemicals							
Asbestos	<0.34	<1	<0.2	<5.1	7	MFL	EPA 100.2
Cyanide	<0.02	<0.02	<0.02	<0.02	150	µg/L	EPA OIA-1677
Perchlorate	<1	<1	2	<1	6	µg/L	EPA 314
Mercury	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.2
Fluoride	0.4	0.3	0.3	0.4	2	mg/L	SM 4500-F C
Aluminum, Dissolved	<25	<25	<25	<25	1000	µg/L	EPA 200.8
Antimony, Dissolved	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic, Dissolved	<2	<2	<2	<2	10	µg/L	EPA 200.8
Barium, Dissolved	27	44	44	40	1000	µg/L	EPA 200.8
Beryllium, Dissolved	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium, Dissolved	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium, Dissolved	<2	<2	4	<2	50	µg/L	EPA 200.8
Hexavalent Chromium, Dissolved	0.5	0.7	3	2	10	µg/L	EPA 218.6
Copper, Dissolved	0.7	0.5	<0.5	<0.5	1300	µg/L	EPA 200.8
Iron, Dissolved	<15	<15	<15	<15	300 (sec.)	µg/L	EPA 200.8
Nickel, Dissolved	10	355	65	180	100	µg/L	EPA 200.8
Manganese, Dissolved	<1	22	<1	8	50 (sec.)	µg/L	EPA 200.8
Selenium, Dissolved	<2	<2	<2	<2	50	µg/L	EPA 200.8
Silver, Dissolved	<0.25	<0.25	<0.25	0.3	100 (sec.)	µg/L	EPA 200.8
Thallium, Dissolved	<1	<1	<1	<1	2	µg/L	EPA 200.8
Zinc, Dissolved	<2	<2	<2	<2	5000 (sec.)	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)							
Benzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Chlorobenzene	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl Tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Total Xylenes	<0.5	<0.5	<0.5	<0.5	1750	µg/L	EPA 524.2
1,2,3-Trichloropropane	<0.005	<0.005	<0.005	<0.005	0.005	µg/L	EPA 524.2

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	8TH-1/1	8TH-1/2	8TH-2/1	8TH-2/2	MCL	Unit	Method
Non-Volatile Synthetic Organic Chemicals (SOCs)							
Alachlor (Alanex)	<0.2	<0.2	<0.1	<0.1	2	µg/L	EPA 505
Atrazine	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	18	µg/L	EPA 531.2
Chlordane	<0.1	<0.1	<0.1	<0.1	0.1	µg/L	EPA 505
2,4-D	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	<0.4	<0.4	<0.4	<0.4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	<4	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.01	<0.01	<0.01	<0.01	2	µg/L	EPA 505
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1
Glyphosate	<25	<25	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Heptachlor Epoxide	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Hexachlorobenzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2
Lindane	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 505
Methoxychlor	<0.01	<0.01	<0.01	<0.01	30	µg/L	EPA 505
Molinate	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2
Oxamyl	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1221	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1232	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1242	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1248	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1254	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1260	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
Simazine	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<0.5	<0.5	<0.5	<0.5	3	µg/L	EPA 505
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (<i>new Federal MCL effective June 25, 2024 are italicized</i>)*							
Perfluorooctanoic acid (PFOA)	7.5	17.2	11.3	13.8	<i>4.0* / 5.1 (NL)</i>	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	14.6	31.1	<2	5.4	<i>4.0* / 6.5 (NL)</i>	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	<2	<2	23.4	3.2	<i>10*</i>	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	5.0	6.2	<2	2.2	<i>10*</i>	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	<2	<2	2.4	<2	<i>1*</i>	ng/L	EPA 537.1
Action Level Chemicals							
Copper, Dissolved	0.7	0.5	<0.5	<0.5	1300	µg/L	EPA 200.8
Lead, Dissolved	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides							
Combined Radium-226 and Radium 228	<3	<3	<3	<3	5.000	pCi/l	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	15	pCi/l	EPA 900.0
Tritium	<300	<300	<300	<300	20,000	pCi/l	EPA 906
Strontium-90	<2	<2	<2	<2	8	pCi/l	EPA 905
Gross Beta Particle Activity	1.3	3.1	1.8	1.7	50	pCi/l	EPA 900.0
Uranium	<1	1	1	<1	20	pCi/l	EPA 200.8

Bold & yellow highlight signifies an exceedance of an Maximum Contaminant Level. Explained in further detail in the report text.

NA: Not available from contract lab at time of reporting

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	BRK-1/1	BRK-1/2	BRK-2/1	BRK-2/2	MCL	Unit	Method
Inorganic Chemicals							
Asbestos	<0.2	<0.2	<0.2	<0.2	7	MFL	EPA 100.2
Cyanide	<0.02	<0.02	<0.02	<0.02	150	µg/L	EPA OIA-1677
Perchlorate	<1	18	4	5	6	µg/L	EPA 314
Mercury	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.2
Fluoride	0.3	0.2	0.3	0.1	2	mg/L	SM 4500-F C
Aluminum, Dissolved	<25	<25	<25	<25	1000	µg/L	EPA 200.8
Antimony, Dissolved	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic, Dissolved	<2	<2	<2	<2	10	µg/L	EPA 200.8
Barium, Dissolved	36	76	39	62	1000	µg/L	EPA 200.8
Beryllium, Dissolved	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium, Dissolved	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium, Dissolved	<2	7	12	7	50	µg/L	EPA 200.8
Hexavalent Chromium, Dissolved	0.4	6	12	7	10	µg/L	EPA 218.6
Copper, Dissolved	1.2	<0.5	<0.5	0.7	1300	µg/L	EPA 200.8
Iron, Dissolved	<15	<15	<15	<15	300 (sec.)	µg/L	EPA 200.8
Nickel, Dissolved	88	3	83	19	100	µg/L	EPA 200.8
Manganese, Dissolved	18	<1	<1	<1	50 (sec.)	µg/L	EPA 200.8
Selenium, Dissolved	<2	<2	<2	<2	50	µg/L	EPA 200.8
Silver, Dissolved	<0.25	<0.25	<0.25	<0.25	100 (sec.)	µg/L	EPA 200.8
Thallium, Dissolved	<1	<1	<1	<1	2	µg/L	EPA 200.8
Zinc, Dissolved	<2	<2	<2	<2	5000 (sec.)	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)							
Benzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Chlorobenzene	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl Tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	2.2	0.8	5	µg/L	EPA 524.2
Toluene	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Total Xylenes	<0.5	<0.5	<0.5	<0.5	1750	µg/L	EPA 524.2
1,2,3-Trichloropropane	<0.5	<0.5	<0.5	<0.5	0.005	µg/L	EPA 524.2

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	BRK-1/1	BRK-1/2	BRK-2/1	BRK-2/2	MCL	Unit	Method
Non-Volatile Synthetic Organic Chemicals (SOCs)							
Alachlor (Alanex)	<0.2	<0.1	<0.1	<0.1	2	µg/L	EPA 505
Atrazine	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	18	µg/L	EPA 531.2
Chlordane	<0.1	<0.1	<0.1	<0.1	0.1	µg/L	EPA 505
2,4-D	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	<0.4	<0.4	<0.4	<0.4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	0.03	<0.01	<0.01	0.2	µg/L	EPA 504.1
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	<4	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.01	<0.01	<0.01	<0.01	2	µg/L	EPA 505
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1
Glyphosate	<5	<5	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Heptachlor Epoxide	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Hexachlorobenzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2
Lindane	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 505
Methoxychlor	<0.01	<0.01	<0.01	<0.01	30	µg/L	EPA 505
Molinate	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2
Oxamyl	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1221	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1232	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1242	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1248	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1254	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1260	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
Simazine	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<0.5	<0.5	<0.5	<0.5	3	µg/L	EPA 505
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (new Federal MCL effective June 25, 2024 are italicized)*							
Perfluorooctanoic acid (PFOA)	14.3	<2	8.7	<2	<i>1.0*</i> / 5.1 (NL)	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	28.0	<2	4.6	<2	<i>1.0*</i> / 6.5 (NL)	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	<2	2.6	5.6	<2	<i>10*</i>	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	4.3	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	<2	<2	<2	<2	<i>1*</i>	ng/L	EPA 537.1
Action Level Chemicals							
Copper, Dissolved	1.2	<0.5	<0.5	0.7	1300	µg/L	EPA 200.8
Lead, Dissolved	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides							
Combined Radium-226 and Radium 228	<3	<3	<3	<3	5.000	pCi/l	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	15	pCi/l	EPA 900.0
Tritium	<300	<300	<300	<300	20,000	pCi/l	EPA 906
Strontium-90	<2	<2	<2	<2	8	pCi/l	EPA 905
Gross Beta Particle Activity	3.6	2.0	2.2	1.1	50	pCi/l	EPA 900.0
Uranium	2	2	1	<1	20	pCi/l	EPA 200.8

Bold & yellow highlight signifies an exceedance of an Maximum Contaminant Level. Explained in further detail in the report text.

NA: Not available from contract lab at time of reporting

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	BH-1/2	Ely MW2	ELY-3	DCZ-2	MCL	Unit	Method
Inorganic Chemicals							
Asbestos	<0.2	<0.2	<0.34	<0.2	7	MFL	EPA 100.2
Cyanide	<0.02	<0.02	<0.02	<0.02	150	µg/L	EPA OIA-1677
Perchlorate	<1	<1	<1	2	6	µg/L	EPA 314
Mercury	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.2
Fluoride	0.1	0.4	0.1	<0.1	2	mg/L	SM 4500-F C
Aluminum, Dissolved	<25	<25	<25	<25	1000	µg/L	EPA 200.8
Antimony, Dissolved	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic, Dissolved	<2	<2	<2	<2	10	µg/L	EPA 200.8
Barium, Dissolved	100	69	15	54	1000	µg/L	EPA 200.8
Beryllium, Dissolved	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium, Dissolved	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium, Dissolved	<2	2	<2	3	50	µg/L	EPA 200.8
Hexavalent Chromium, Dissolved	2	2	0.4	2	10	µg/L	EPA 218.6
Copper, Dissolved	0.6	1.0	1.1	1.1	1300	µg/L	EPA 200.8
Iron, Dissolved	<15	<15	<15	<15	300 (sec.)	µg/L	EPA 200.8
Nickel, Dissolved	7	5	3	20	100	µg/L	EPA 200.8
Manganese, Dissolved	<1	<1	<1	<1	50 (sec.)	µg/L	EPA 200.8
Selenium, Dissolved	<2	<2	<2	<2	50	µg/L	EPA 200.8
Silver, Dissolved	0.4	<0.25	<0.25	<0.25	100 (sec.)	µg/L	EPA 200.8
Thallium, Dissolved	<1	<1	<1	<1	2	µg/L	EPA 200.8
Zinc, Dissolved	<2	<2	<2	153	5000 (sec.)	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)							
Benzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropene	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Chlorobenzene	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl Tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Total Xylenes	<0.5	<0.5	<0.5	<0.5	1750	µg/L	EPA 524.2
1,2,3-Trichloropropane	<0.5	<0.5	<0.5	<0.5	0.005	µg/L	EPA 524.2

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	BH-1/2	Ely MW2	ELY-3	DCZ-2	MCL	Unit	Method
Non-Volatile Synthetic Organic Chemicals (SOCs)							
Alachlor (Alanex)	<0.1	<0.2	<0.1	<0.1	2	µg/L	EPA 505
Atrazine	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	18	µg/L	EPA 531.2
Chlordane	<0.1	<0.1	<0.1	<0.1	0.1	µg/L	EPA 505
2,4-D	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	<0.4	<0.4	<0.4	<0.4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	<4	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.01	<0.01	<0.01	<0.01	2	µg/L	EPA 505
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1
Glyphosate	<25	<25	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Heptachlor Epoxide	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Hexachlorobenzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2
Lindane	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 505
Methoxychlor	<0.01	<0.01	<0.01	<0.01	30	µg/L	EPA 505
Molinate	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2
Oxamyl	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1221	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1232	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1242	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1248	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1254	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1260	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
Simazine	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<0.5	<0.5	<0.5	<0.5	3	µg/L	EPA 505
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (<i>new Federal MCL effective June 25, 2024 are italicized</i>)*							
Perfluorooctanoic acid (PFOA)	15.1	8.3	10.2	12.9	1.0* / 5.1 (NL)	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	2.1	18.4	15.4	5.9	1.0* / 6.5 (NL)	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	5.0	8.0	4.4	2.7	10*	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	<2	<2	<2	<2	10*	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	<2	<2	<2	<2	10*	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	<2	<2	<2	<2	1*	ng/L	EPA 537.1
Action Level Chemicals							
Copper, Dissolved	0.6	1.0	1.1	1.1	1300	µg/L	EPA 200.8
Lead, Dissolved	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides							
Combined Radium-226 and Radium 228	<3	<3	<3	<3	5.000	pCi/l	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	15	pCi/l	EPA 900.0
Tritium	<300	<300	<300	<300	20,000	pCi/l	EPA 906
Strontium-90	<2	<2	<2	<2	8	pCi/l	EPA 905
Gross Beta Particle Activity	2.1	1.5	0.3	2.3	50	pCi/l	EPA 900.0
Uranium	<1	2	<1	2	20	pCi/l	EPA 200.8

Bold & yellow highlight signifies an exceedance of an Maximum Contaminant Level. Explained in further detail in the report text.

NA: Not available from contract lab at time of reporting

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	RP3-1/1	Southridge JHS	T-1/2	T-2/2	MCL	Unit	Method
Inorganic Chemicals							
Asbestos	<0.2	<0.2	<0.2	<0.34	7	MFL	EPA 100.2
Cyanide	<0.02	<0.02	<0.02	<0.02	150	µg/L	EPA OIA-1677
Perchlorate	<1	5	<1	1	6	µg/L	EPA 314
Mercury	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.2
Fluoride	<0.1	0.2	0.3	0.3	2	mg/L	SM 4500-F C
Aluminum, Dissolved	<25	<25	<25	<25	1000	µg/L	EPA 200.8
Antimony, Dissolved	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic, Dissolved	<2	<2	2	<2	10	µg/L	EPA 200.8
Barium, Dissolved	93	161	37	44	1000	µg/L	EPA 200.8
Beryllium, Dissolved	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium, Dissolved	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium, Dissolved	2.4	3.4	<2	<2	50	µg/L	EPA 200.8
Hexavalent Chromium, Dissolved	2.6	3.0	0.2	0.5	10	µg/L	EPA 218.6
Copper, Dissolved	3.0	1.9	0.9	1.5	1300	µg/L	EPA 200.8
Iron, Dissolved	<15	<15	<15	<15	300 (sec.)	µg/L	EPA 200.8
Nickel, Dissolved	180	4	2	4	100	µg/L	EPA 200.8
Manganese, Dissolved	64	2	<1	<1	50 (sec.)	µg/L	EPA 200.8
Selenium, Dissolved	<2	3	<2	<2	50	µg/L	EPA 200.8
Silver, Dissolved	<0.25	<0.25	<0.25	0.5	100 (sec.)	µg/L	EPA 200.8
Thallium, Dissolved	<1	<1	<1	<1	2	µg/L	EPA 200.8
Zinc, Dissolved	<2	6	<2	<2	5000 (sec.)	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)							
Benzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropane	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Chlorobenzene	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl Tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Total Xylenes	<0.5	<0.5	<0.5	<0.5	1750	µg/L	EPA 524.2
1,2,3-Trichloropropane	<0.5	<0.5	<0.5	<0.5	0.005	µg/L	EPA 524.2

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	RP3-1/1	Southridge JHS	T-1/2	T-2/2	MCL	Unit	Method
Non-Volatile Synthetic Organic Chemicals (SOCs)							
Alachlor (Alanex)	<0.1	<0.1	<0.1	<0.1	2	µg/L	EPA 505
Atrazine	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	18	µg/L	EPA531.2
Chlordane	<0.1	<0.1	<0.1	<0.1	0.1	µg/L	EPA 505
2,4-D	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	<0.4	<0.4	<0.4	<0.4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	<4	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.01	<0.01	<0.01	<0.01	2	µg/L	EPA 505
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1
Glyphosate	<25	<25	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Heptachlor Epoxide	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Hexachlorobenzene	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2
Lindane	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 505
Methoxychlor	<0.01	<0.01	<0.01	<0.01	30	µg/L	EPA 505
Molinate	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2
Oxamyl	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1221	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1232	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1242	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1248	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1254	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1260	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
Simazine	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<0.5	<0.5	<0.5	<0.5	3	µg/L	EPA 505
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (<i>new Federal MCL effective June 25, 2024 are italicized</i>)*							
Perfluorooctanoic acid (PFOA)	5.3	<2	9.5	12.0	<i>1.0*</i> / 5.1 (NL)	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	6.0	<2	25.0	15.0	<i>1.0*</i> / 6.5 (NL)	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	<2	4.2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	<2	<2	3.2	2.8	<i>10*</i>	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	<2	<2	<2	<2	<i>1*</i>	ng/L	EPA 537.1
Action Level Chemicals							
Copper, Dissolved	3.0	1.9	0.9	1.5	1300	µg/L	EPA 200.8
Lead, Dissolved	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides							
Combined Radium-226 and Radium 228	<3	<3	<3	<3	5.000	pCi/l	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	15	pCi/l	EPA 900.0
Tritium	<300	<300	<300	521	20,000	pCi/l	EPA 906
Strontium-90	<2	<2	<2	<2	8	pCi/l	EPA 905
Gross Beta Particle Activity	3	7.6	1.5	1.2	50	pCi/l	EPA 900.0
Uranium	<1	6	<1	<1	20	pCi/l	EPA 200.8

Bold & yellow highlight signifies an exceedance of an Maximum Contaminant Level. Explained in further detail in the report text.

NA: Not available from contract lab at time of reporting

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	SS-1/1	SSV-2	VCT-1/1	VCT-2/2	Unitex 91090	MCL	Unit	Method
Inorganic Chemicals								
Asbestos	<1	<1	<0.2	0.2	<0.2	7	MFL	EPA 100.2
Cyanide	<0.02	<0.02	<0.02	<0.02	<0.02	150	µg/L	EPA OIA-1677
Perchlorate	<1	<1	<1	1	<1	6	µg/L	EPA 314
Mercury	<0.5	<0.5	<0.5	<0.5	<0.5	2	µg/L	EPA 245.2
Fluoride	0.1	0.1	<0.1	0.1	0.1	2	mg/L	SM 4500-F C
Aluminum, Dissolved	<25	<25	<25	<25	<25	1000	µg/L	EPA 200.8
Antimony, Dissolved	<1	<1	<1	<1	<1	6	µg/L	EPA 200.8
Arsenic, Dissolved	<2	<2	<2	<2	<2	10	µg/L	EPA 200.8
Barium, Dissolved	68	49	129	63	44	1000	µg/L	EPA 200.8
Beryllium, Dissolved	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 200.8
Cadmium, Dissolved	<0.25	<0.25	<0.25	<0.25	<0.25	5	µg/L	EPA 200.8
Chromium, Dissolved	<2	<2	<2	3.2	<2	50	µg/L	EPA 200.8
Hexavalent Chromium, Dissolved	1.3	0.4	0.7	2.5	0.8	10	µg/L	EPA 218.6
Copper, Dissolved	0.8	1.1	1.0	0.6	0.7	1300	µg/L	EPA 200.8
Iron, Dissolved	<15	<15	<15	<15	<15	300 (sec.)	µg/L	EPA 200.8
Nickel, Dissolved	11	12	8	3	1	100	µg/L	EPA 200.8
Manganese, Dissolved	2	<1	<1	<1	<1	50 (sec.)	µg/L	EPA 200.8
Selenium, Dissolved	<2	<2	<2	<2	<2	50	µg/L	EPA 200.8
Silver, Dissolved	<0.25	<0.25	<0.25	<0.25	<0.25	100 (sec.)	µg/L	EPA 200.8
Thallium, Dissolved	<1	<1	<1	<1	<1	2	µg/L	EPA 200.8
Zinc, Dissolved	<2	<2	<2	4	<2	5000 (sec.)	µg/L	EPA 200.8
Volatile Organic Chemicals (VOCs)								
Benzene	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Carbon Tetrachloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,2-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	600	µg/L	EPA 524.2
1,4-Dichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
1,1-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
cis-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	6	µg/L	EPA 524.2
trans-1,2-Dichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	10	µg/L	EPA 524.2
Dichloromethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,2-Dichloropropane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,3-Dichloropropane	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Ethylbenzene	<0.5	<0.5	<0.5	<0.5	<0.5	300	µg/L	EPA 524.2
Chlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 524.2
Methyl Tert-butyl ether (MTBE)	<0.5	<0.5	<0.5	<0.5	<0.5	13	µg/L	EPA 524.2
Styrene	<0.5	<0.5	<0.5	<0.5	<0.5	100	µg/L	EPA 524.2
1,1,2,2-Tetrachloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 524.2
Tetrachloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Toluene	<0.5	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,2,4-Trichlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
1,1,1-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	200	µg/L	EPA 524.2
1,1,2-Trichloroethane	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichloroethylene	<0.5	<0.5	<0.5	<0.5	<0.5	5	µg/L	EPA 524.2
Trichlorofluoromethane	<0.5	<0.5	<0.5	<0.5	<0.5	150	µg/L	EPA 524.2
1,1,2-Trichloro-1,2,2-Trifluoroethane	<0.5	<0.5	<0.5	<0.5	<0.5	1200	µg/L	EPA 524.2
Vinyl Chloride	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 524.2
Total Xylenes	<0.5	<0.5	<0.5	<0.5	<0.5	1750	µg/L	EPA 524.2
1,2,3-Trichloropropane	<0.5	<0.5	<0.5	<0.5	<0.5	0.005	µg/L	EPA 524.2

Table 2-9b
Groundwater Monitoring Well Results (Annual)

Constituent	SS-1/1	SSV-2	VCT-1/1	VCT-2/2	Unitex 91090	MCL	Unit	Method
Non-Volatile Synthetic Organic Chemicals (SOCs)								
Alachlor (Alanex)	<0.1	<0.1	<0.1	<0.1	<0.2	2	µg/L	EPA 505
Atrazine	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Bentazon	<2	<2	<2	<2	<2	18	µg/L	EPA 515.4
Benzo(a)pyrene	<0.1	<0.1	<0.1	<0.1	<0.1	0.2	µg/L	EPA 525.2
Carbofuran	<2	<2	<2	<2	<2	18	µg/L	EPA531.2
Chlordane	<0.01	<0.01	<0.01	<0.01	<0.01	0.1	µg/L	EPA 505
2,4-D	<0.4	<0.4	<0.4	<0.4	<0.4	70	µg/L	EPA 515.4
Dalapon	<0.4	<0.4	<0.4	<0.4	<0.4	200	µg/L	EPA 515.4
Dibromochloropropane	<0.01	<0.01	<0.01	<0.01	<0.01	0.2	µg/L	EPA 504.1
Di(2-ethylhexyl)adipate	<0.5	<0.5	<0.5	<0.5	<0.5	400	µg/L	EPA 525.2
Di(2-ethylhexyl)phthalate	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Dinoseb	<0.4	<0.4	<0.4	<0.4	<0.4	7	µg/L	EPA 515.4
Diquat	<4	<4	<4	<4	<4	20	µg/L	EPA 549.2
Endothall	<45	<45	<45	<45	<45	100	µg/L	EPA 548.1
Endrin	<0.01	<0.01	<0.01	<0.01	<0.01	2	µg/L	EPA 505
Ethylene Dibromide	<0.02	<0.02	<0.02	<0.02	<0.02	0.05	µg/L	EPA 504.1
Glyphosate	<5	<25	<25	<25	<25	700	µg/L	EPA 547
Heptachlor	<0.01	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Heptachlor Epoxide	<0.01	<0.01	<0.01	<0.01	<0.01	0.01	µg/L	EPA 505
Hexachlorobenzene	<0.5	<0.5	<0.5	<0.5	<0.5	1	µg/L	EPA 525.2
Hexachlorocyclopentadiene	<0.5	<0.5	<0.5	<0.5	<0.5	50	µg/L	EPA 525.2
Lindane	<0.01	<0.01	<0.05	<0.01	<0.01	0.2	µg/L	EPA 505
Methoxychlor	<0.01	<0.01	<0.05	<0.01	<0.01	30	µg/L	EPA 505
Molinate	<0.5	<0.5	<0.5	<0.5	<0.5	20	µg/L	EPA 525.2
Oxamyl	<2	<2	<2	<2	<2	50	µg/L	EPA 531.2
Pentachlorophenol	<0.2	<0.2	<0.2	<0.2	<0.2	1	µg/L	EPA 515.4
Picloram	<0.6	<0.6	<0.6	<0.6	<0.6	500	µg/L	EPA 515.4
PCB 1016	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1221	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1232	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1242	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1248	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1254	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
PCB 1260	<0.5	<0.5	<0.5	<0.5	<0.5	0.5	µg/L	EPA 505
Simazine	<0.5	<0.5	<0.5	<0.5	<0.5	4	µg/L	EPA 525.2
Thiobencarb	<0.5	<0.5	<0.5	<0.5	<0.5	70	µg/L	EPA 525.2
Toxaphene	<0.5	<0.5	<0.5	<0.5	<0.5	3	µg/L	EPA 505
2,3,7,8-TCDD (Dioxin)	<5	<5	<5	<5	<5	30	pg/L	EPA 1613
2,4,5-TP (Silvex)	<0.2	<0.2	<0.2	<0.2	<0.2	50	µg/L	EPA 515.4
Per- and Poly-fluoroalkyl Substances (<i>new Federal MCL effective June 25, 2024 are italicized</i>) *								
Perfluorooctanoic acid (PFOA)	4.7	<2	14.0	<2	7.1	<i>1.0*</i> / 5.1 (NL)	ng/L	EPA 537.1
Perfluorooctanesulfonic acid (PFOS)	<2	<2	15.9	<2	6.7	<i>1.0*</i> / 6.5 (NL)	ng/L	EPA 537.1
Perfluorohexanesulfonic acid (PFHxS)	<2	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Perfluorononanoic Acid (PFNA)	<2	<2	7.1	<2	<2	<i>10*</i>	ng/L	EPA 537.1
Hexafluoropropylene oxide dimer acid	<2	<2	<2	<2	<2	<i>10*</i>	ng/L	EPA 537.1
PFHxS, PFNA, HFPO-DA, PFBS	<2	<2	<2	<2	<2	<i>1*</i>	ng/L	EPA 537.1
Action Level Chemicals								
Copper, Dissolved	0.8	1.1	1.0	0.6	0.7	1300	µg/L	EPA 200.8
Lead, Dissolved	<0.5	<0.5	<0.5	<0.5	<0.5	15	µg/L	EPA 200.8
Radionuclides								
Combined Radium-226 and Radium 228	<3	<3	<3	<3	<3	5.000	pCi/l	EPA 903.0
Gross Alpha Particle Activity	<3	<3	<3	<3	<3	15	pCi/l	EPA 900.0
Tritium	<300	<300	<300	<300	303	20,000	pCi/l	EPA 906
Strontium-90	<2	<2	<2	<2	<2	8	pCi/l	EPA 905
Gross Beta Particle Activity	2.2	2.5	2.9	<3	1.1	50	pCi/l	EPA 900.0
Uranium	<1	<1	<1	<1	<1	20	pCi/l	EPA 200.8

Bold & yellow highlight signifies an exceedance of an Maximum Contaminant Level. Explained in further detail in the report text.

NA: Not available from contract lab at time of reporting

Table 3-1
Diluent & Recycled Water Recharge Volume (Acre-Feet)

Date	Diluent Water																				Recycled Water									
	Imported Water										Local Runoff / Storm Flow										Recycled Water									
	7th & 8th St.	Banana	Brooks	Declez	Ely	Hickory	RP3	San Sevaine	Turner	Victoria	7th & 8th St.	Banana	Brooks	Declez	Ely	Hickory	RP3	San Sevaine	Turner	Victoria	7th & 8th St.	Banana	Brooks	Declez	Ely	Hickory	RP3	San Sevaine	Turner	Victoria
Jan-24	0	0	0	0	0	0	0	74	0	0	159	42	79	149	259	48	130	141	140	92	22	0	35	0	0	52	385	155	55	30
Feb-24	0	0	0	0	0	0	0	0	0	0	226	73	272	178	527	128	383	787	359	213	0	0	0	0	0	0	52	113	55	12
Mar-24	0	0	0	0	0	0	0	0	0	0	174	72	141	191	457	129	226	509	272	224	23	273	0	18	0	64	106	128	38	19
1Q24 Total	0	0	0	0	0	0	0	74	0	0	559	187	491	518	1243	305	739	1437	770	529	45	273	35	18	0	117	543	396	149	61
April-24	0	0	0	0	0	0	0	30	0	0	74	28	27	54	78	8	46	98	91	46	24	313	0	49	0	89	307	170	95	110
May-24	0	0	0	0	0	0	21	498	0	0	40	0	15	5	19	18	47	61	11	17	3	0	55	0	0	240	476	138	163	174
June-24	0	0	0	0	0	0	23	370	0	0	2	0	0	2	3	0	12	9	13	1	0	0	117	0	68	213	427	112	155	172
2Q24 Total	0	0	0	0	0	0	44	898	0	0	116	28	42	61	100	26	105	168	115	64	27	313	172	49	68	542	1210	420	412	456
July-24	0	0	0	0	0	0	0	473	0	0	5	0	3	2	8	0	7	0	13	2	0	30	132	0	11	272	460	113	75	235
Aug-24	0	0	0	0	0	16	0	456	0	0	10	0	1	2	1	0	7	0	15	2	0	18	81	0	60	166	509	60	117	171
Sep-24	0	0	0	0	0	0	29	471	0	0	17	0	1	8	0	0	2	0	13	1	0	9	43	169	0	85	1046	76	114	65
3Q24 Total	0	0	0	0	0	16	29	1400	0	0	31	0	5	12	9	0	17	0	41	4	0	58	256	169	70	522	2014	249	307	472
Oct-24	0	0	0	0	0	0	24	469	0	0	48	6	5	29	0	1	0	3	38	4	187	17	59	173	0	155	628	106	247	118
Nov-24	0	0	0	0	0	0	14	334	0	0	76	31	5	7	0	19	0	7	78	2	324	17	154	184	0	29	218	133	203	148
Dec-24	0	0	0	0	0	0	0	39	0	0	3	0	3	3	0	0	0	0	21	1	398	79	111	237	0	79	150	252	374	113
4Q24 Total	0	0	0	0	0	0	38	842	0	0	127	37	12	39	0	19	0	10	137	7	910	113	324	594	0	263	995	491	824	378

Table 6-1
MVWD ASR Project - TIN/TDS Mass Balance

ASR Well No. 4										
	Date	Injection			Recovery			Mass Balance		
		Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)
1Q24	Jan-24	0.0	0.7	230	0	13.0	400	(2,520)	(44,707)	(1,234,291)
	Feb-24	0.0	0.7	230	0	13.0	400	(2,521)	(44,711)	(1,234,404)
	Mar-24	0.0	0.7	230	0	13.0	400	(2,521)	(44,714)	(1,234,513)
2Q24	Apr-24	0.0	0.7	260	0	13.0	400	(2,521)	(44,720)	(1,234,676)
	May-24	0.0	0.7	260	0	13.0	400	(2,521)	(44,724)	(1,234,794)
	Jun-24	0.0	0.7	260	0	13.0	400	(2,522)	(44,728)	(1,234,932)
3Q24	Jul-24	0.0	0.4	220	4	13.0	400	(2,525)	(44,787)	(1,236,739)
	Aug-24	0.0	0.4	220	0	13.0	400	(2,526)	(44,790)	(1,236,852)
	Sep-24	0.0	0.4	220	0	13.0	400	(2,526)	(44,794)	(1,236,961)
4Q24	Oct-24	0.0	<0.2	170	0	13.0	400	(2,526)	(44,799)	(1,237,123)
	Sep-24	0.0	<0.2	170	0	13.0	400	(2,526)	(44,801)	(1,237,173)
	Dec-24	0.0	<0.2	170	0	13.0	400	(2,526)	(44,805)	(1,237,286)

ASR Well No. 30										
	Date	Injection			Recovery			Mass Balance		
		Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)
1Q24	Jan-24	0.0	0.7	230	135	12.0	250	(562)	(60,074)	(687,037)
	Feb-24	0.0	0.7	230	0	12.0	250	(562)	(60,074)	(687,037)
	Mar-24	0.0	0.7	230	0	12.0	250	(562)	(60,074)	(687,037)
2Q24	Apr-24	0.0	0.7	260	0	12.0	250	(562)	(60,074)	(687,037)
	May-24	0.0	0.7	260	0	12.0	250	(562)	(60,074)	(687,037)
	Jun-24	0.0	0.7	260	0	12.0	250	(562)	(60,074)	(687,037)
3Q24	Jul-24	0.0	0.4	220	0	12.0	250	(562)	(60,074)	(687,037)
	Aug-24	0.0	0.4	220	0	12.0	250	(562)	(60,074)	(687,037)
	Sep-24	0.0	0.4	220	0	12.0	250	(562)	(60,074)	(687,037)
4Q24	Oct-24	0.0	<0.2	170	0	12.0	250	(562)	(60,074)	(687,037)
	Sep-24	0.0	<0.2	170	0	12.0	250	(562)	(60,074)	(687,037)
	Dec-24	0.0	<0.2	170	0	12.0	250	(562)	(60,074)	(687,037)

ASR Well No. 32										
	Date	Injection			Recovery			Mass Balance		
		Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)
1Q24	Jan-24	0.0	0.7	230	0	12.0	330	(2,568)	(48,369)	(662,633)
	Feb-24	0.0	0.7	230	0	12.0	330	(2,568)	(48,369)	(662,633)
	Mar-24	0.0	0.7	230	0	12.0	330	(2,568)	(48,369)	(662,633)
2Q24	Apr-24	0.0	0.7	260	0	12.0	330	(2,568)	(48,369)	(662,633)
	May-24	0.0	0.7	260	0	12.0	330	(2,568)	(48,369)	(662,633)
	Jun-24	0.0	0.7	260	0	12.0	330	(2,568)	(48,369)	(662,633)
3Q24	Jul-24	0.0	0.4	220	0	12.0	330	(2,568)	(48,369)	(662,645)
	Aug-24	0.0	0.4	220	0	12.0	330	(2,568)	(48,369)	(662,658)
	Sep-24	0.0	0.4	220	0	12.0	330	(2,568)	(48,369)	(662,658)
4Q24	Oct-24	0.0	<0.2	170	0	12.0	330	(2,568)	(48,371)	(662,706)
	Sep-24	0.0	<0.2	170	0	12.0	330	(2,568)	(48,371)	(662,706)
	Dec-24	0.0	<0.2	170	0	12.0	330	(2,568)	(48,371)	(662,706)

The injected water is WFA-treated water, which meets CCR Title 22 drinking water


Cells shaded in grey reflect most recent lab values.

Table 6-1
MVWD ASR Project - TIN/TDS Mass Balance

ASR Well No. 33										
Date	Injection			Recovery			Mass Balance			
	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Volume (AF)	TIN (mg/L)	TDS (mg/L)	Storage (AF)	TIN (kg)	TDS (kg)	
1Q24	Jan-24	0.0	0.7	230	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Feb-24	0.0	0.7	230	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Mar-24	0.0	0.7	230	0	12.0	320	(2,061)	(79,681)	(1,153,705)
2Q24	Apr-24	0.0	0.7	260	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	May-24	0.0	0.7	260	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Jun-24	0.0	0.7	260	0	12.0	320	(2,061)	(79,681)	(1,153,705)
3Q24	Jul-24	0.0	0.4	220	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Aug-24	0.0	0.4	220	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Sep-24	0.0	0.4	220	0	12.0	320	(2,061)	(79,681)	(1,153,705)
4Q24	Oct-24	0.0	<0.2	170	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Sep-24	0.0	<0.2	170	0	12.0	320	(2,061)	(79,681)	(1,153,705)
	Dec-24	0.0	<0.2	170	0	12.0	320	(2,061)	(79,681)	(1,153,705)

The injected water is WFA-treated water, which meets CCR Title 22 drinking water
Cells shaded in grey reflect most recent lab values.

Total Project (All Wells)					
Date		Mass Balance			
		Storage (AF)	TIN (kg)	TDS (kg)	
1Q24	Jan-24	(7,712)	(232,830)	(3,737,667)	
	Feb-24	(7,712)	(232,834)	(3,737,780)	
	Mar-24	(7,712)	(232,838)	(3,737,889)	
2Q24	Apr-24	(7,713)	(232,843)	(3,738,052)	
	May-24	(7,713)	(232,847)	(3,738,170)	
	Jun-24	(7,713)	(232,851)	(3,738,308)	
3Q24	Jul-24	(7,717)	(232,910)	(3,740,127)	
	Aug-24	(7,717)	(232,915)	(3,740,252)	
	Sep-24	(7,717)	(232,918)	(3,740,361)	
4Q24	Oct-24	(7,718)	(232,925)	(3,740,573)	
	Sep-24	(7,718)	(232,927)	(3,740,622)	
	Dec-24	(7,718)	(232,930)	(3,740,735)	

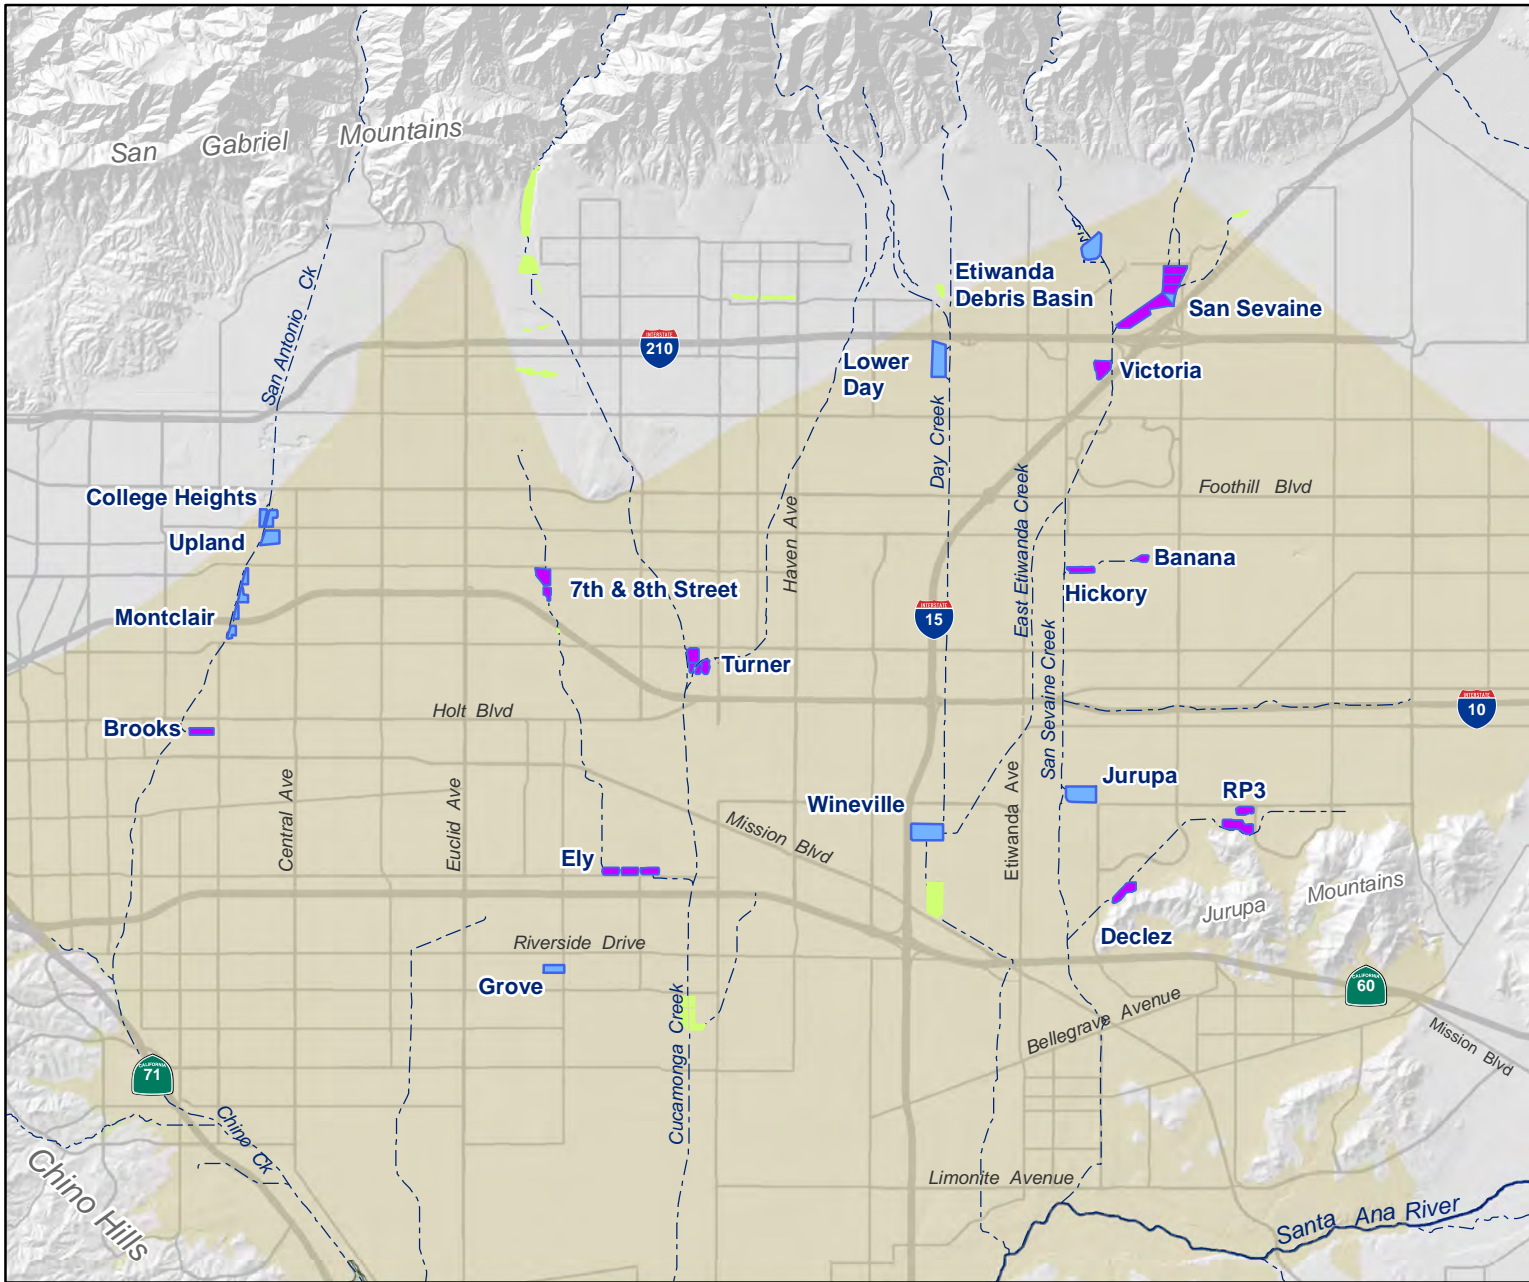

- Recharge Basins in the Recycled Water Groundwater Recharge Program
- Recharge Basins in the Recycled Water Groundwater Recharge Program (Active Recycled Water Recharge)
- Non-Program Basins
- Chino Groundwater Basin
- Rivers and Streams



Chino Basin Recycled Water Groundwater Recharge Program

Basin Locations


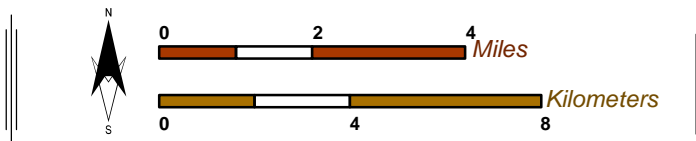


Figure 1-1



Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin

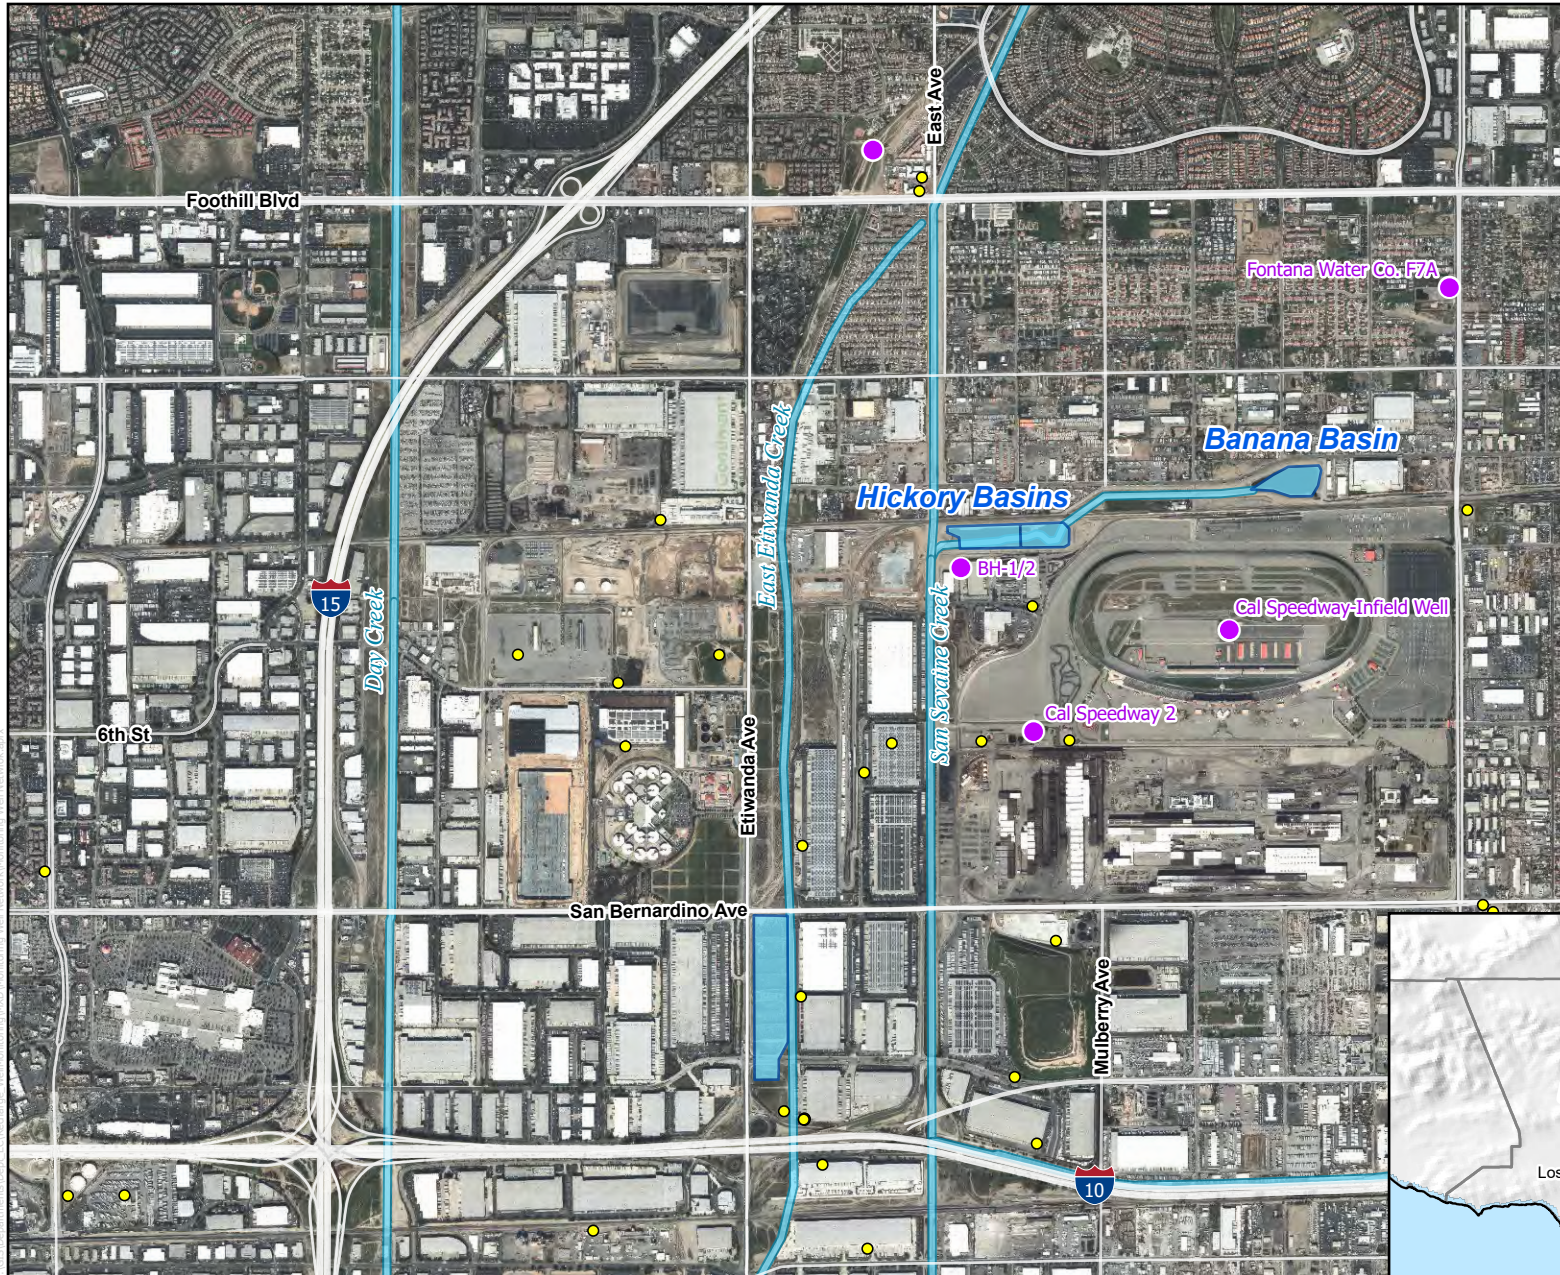



Monitoring Well Network

Hickory and Banana Basins

Figure 2-1

Recycled Water Recharge Program



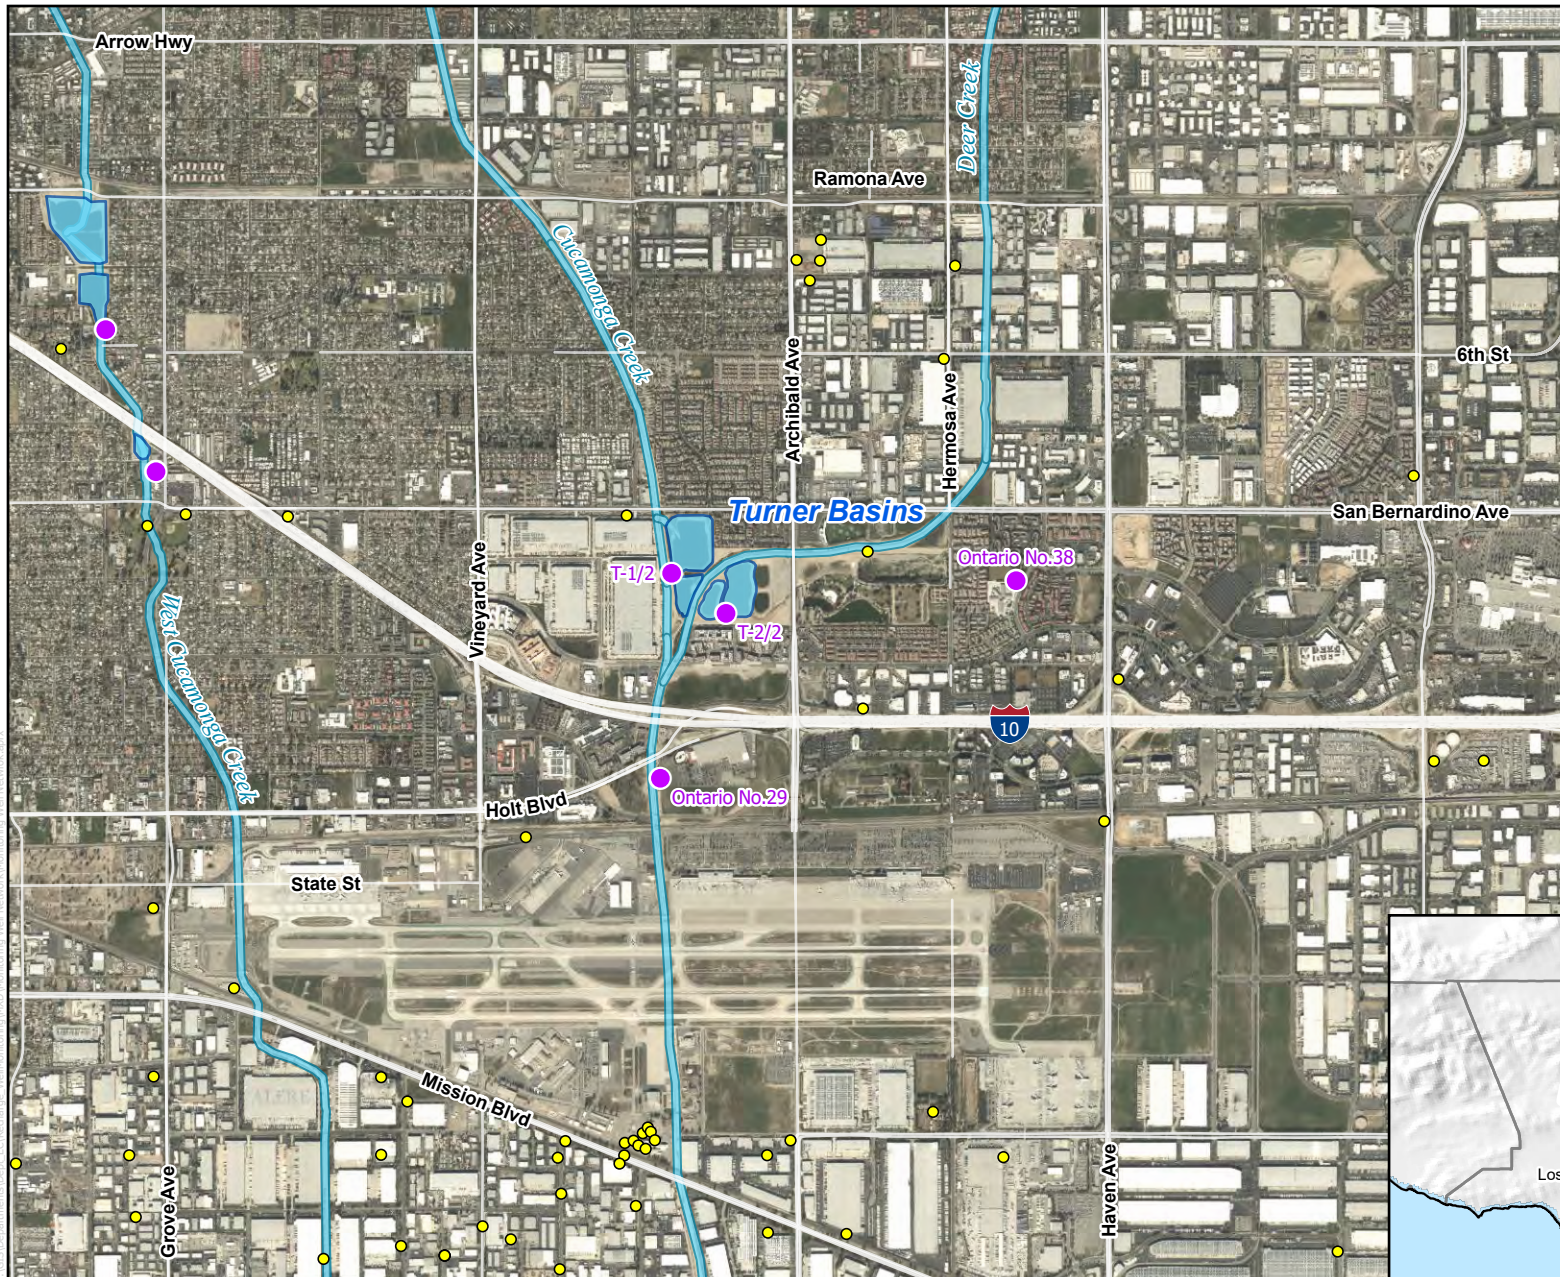


Main Map Features


- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin



Monitoring Well Network
Turner Basins
Figure 2-2

Recycled Water Recharge Program



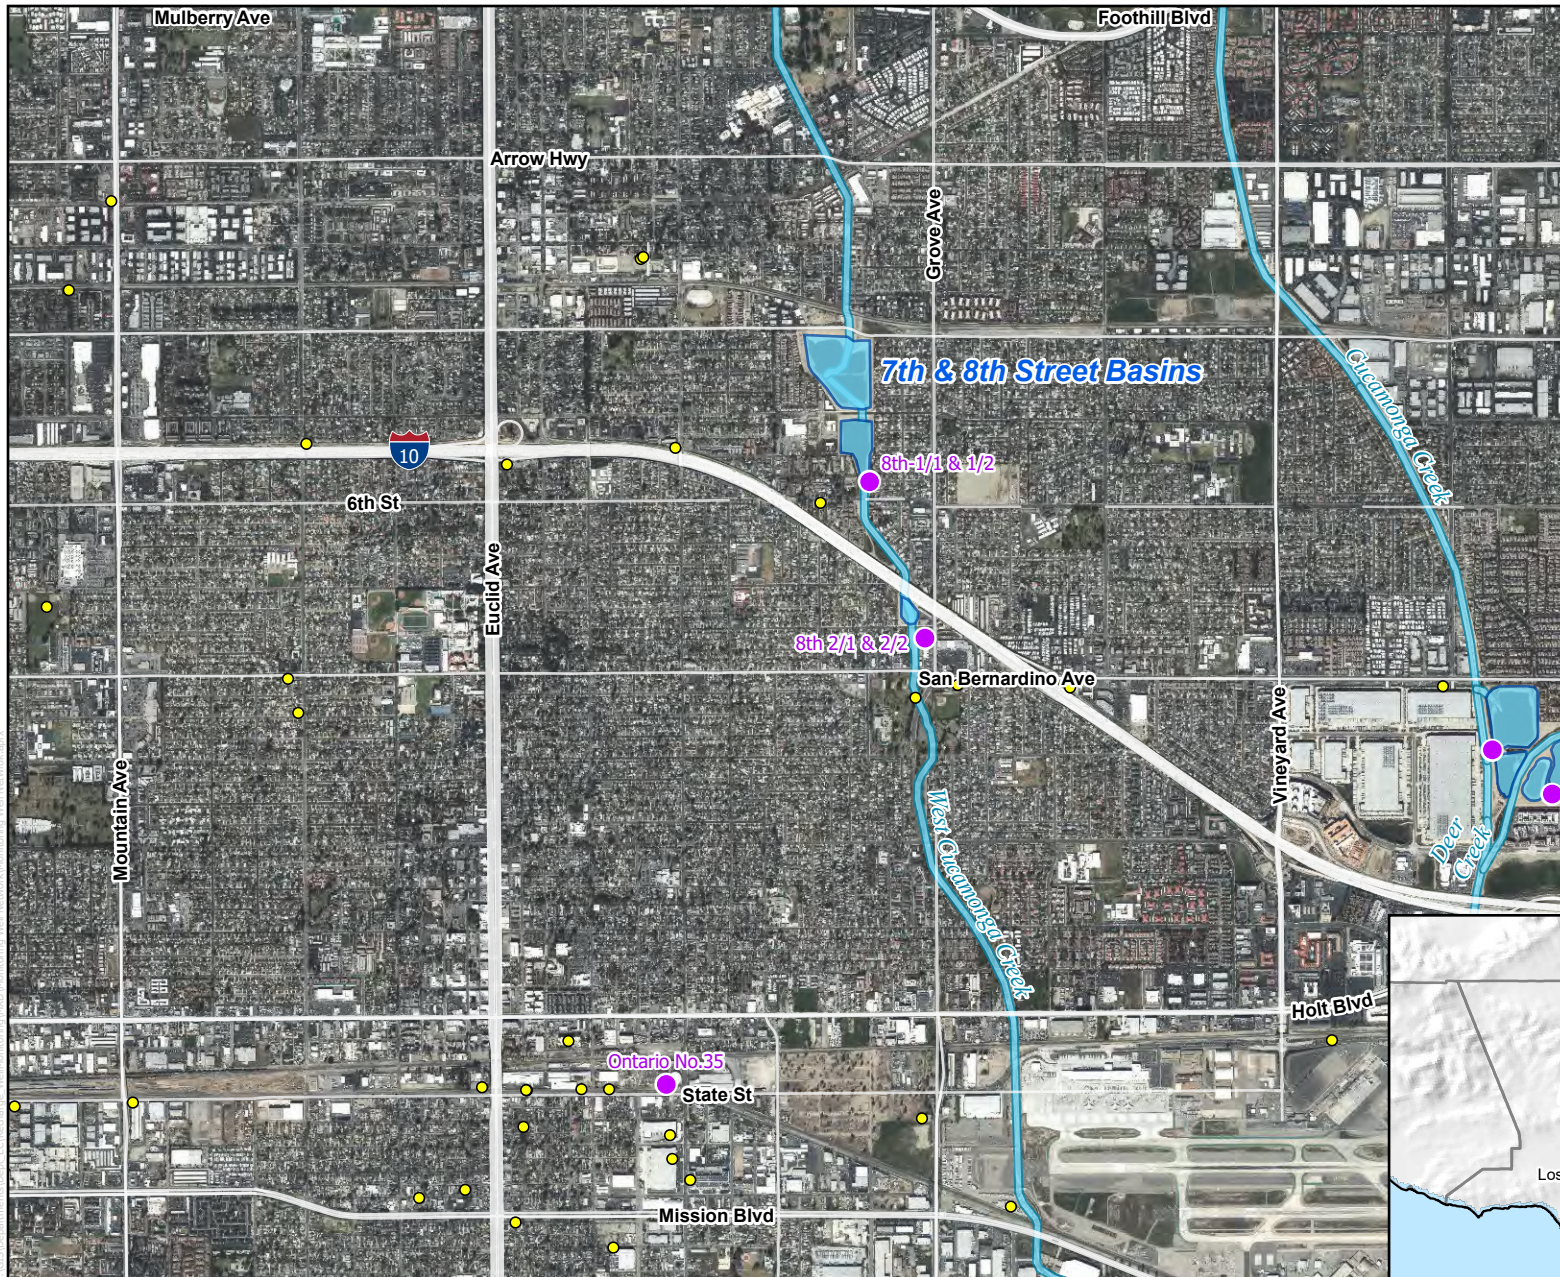

Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin





Monitoring Well Network

7th and 8th Street Basins

Figure 2-3

Recycled Water Recharge Program



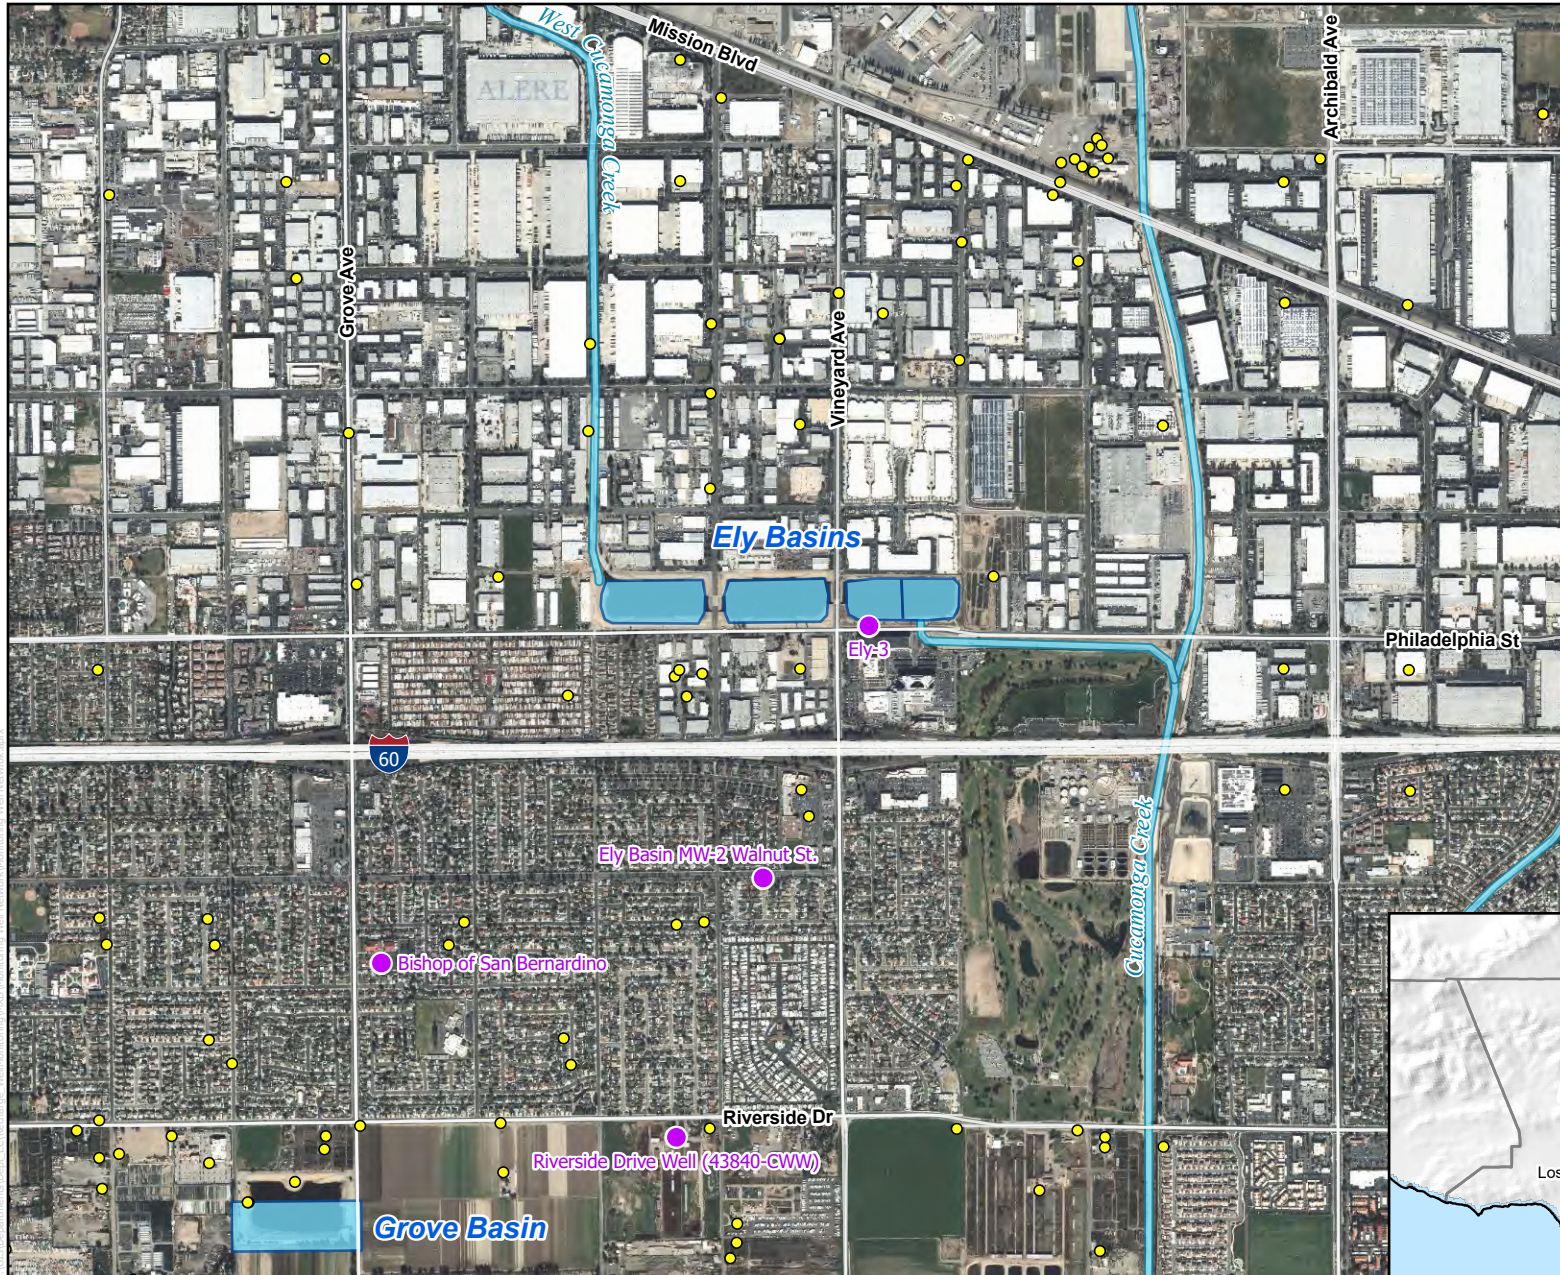

Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin





Monitoring Well Network

Ely Basins

Figure 2-4

Recycled Water Recharge Program



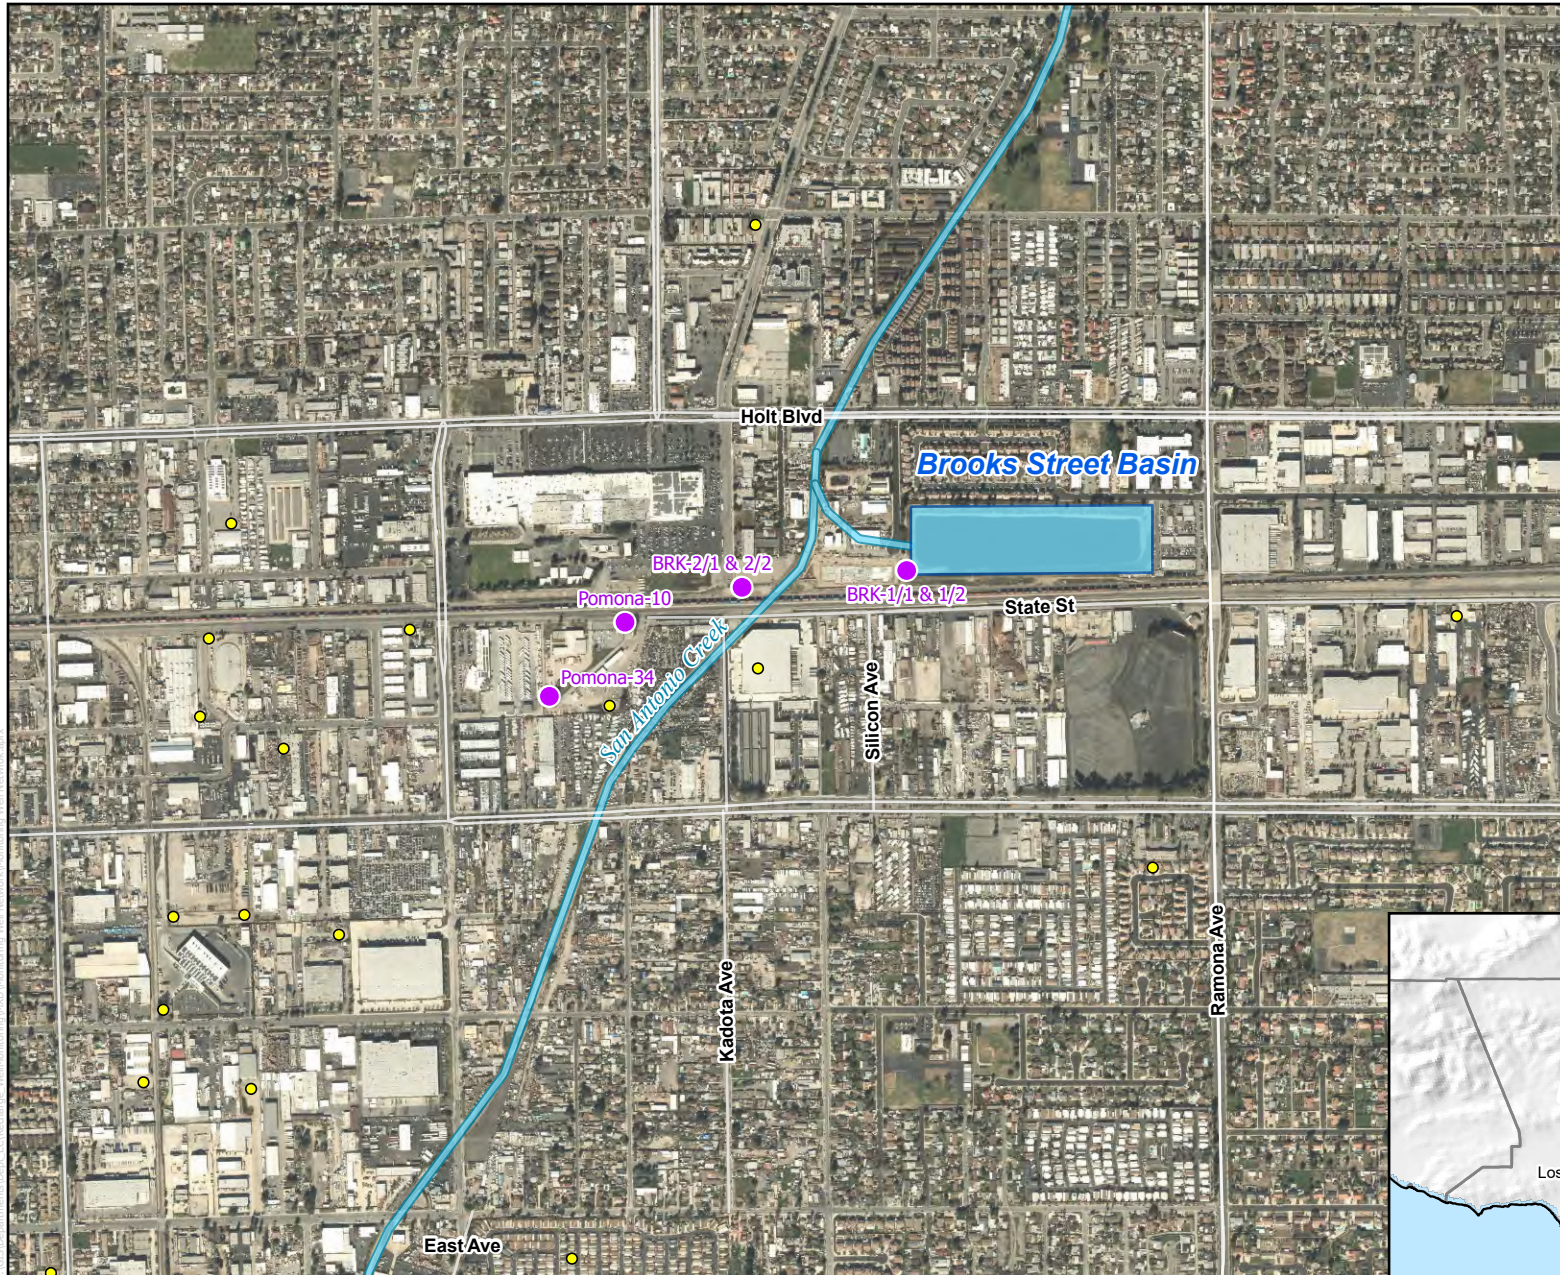

Main Map Features


- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin



Monitoring Well Network
Brooks Street Basin
Figure 2-5

Recycled Water Recharge Program



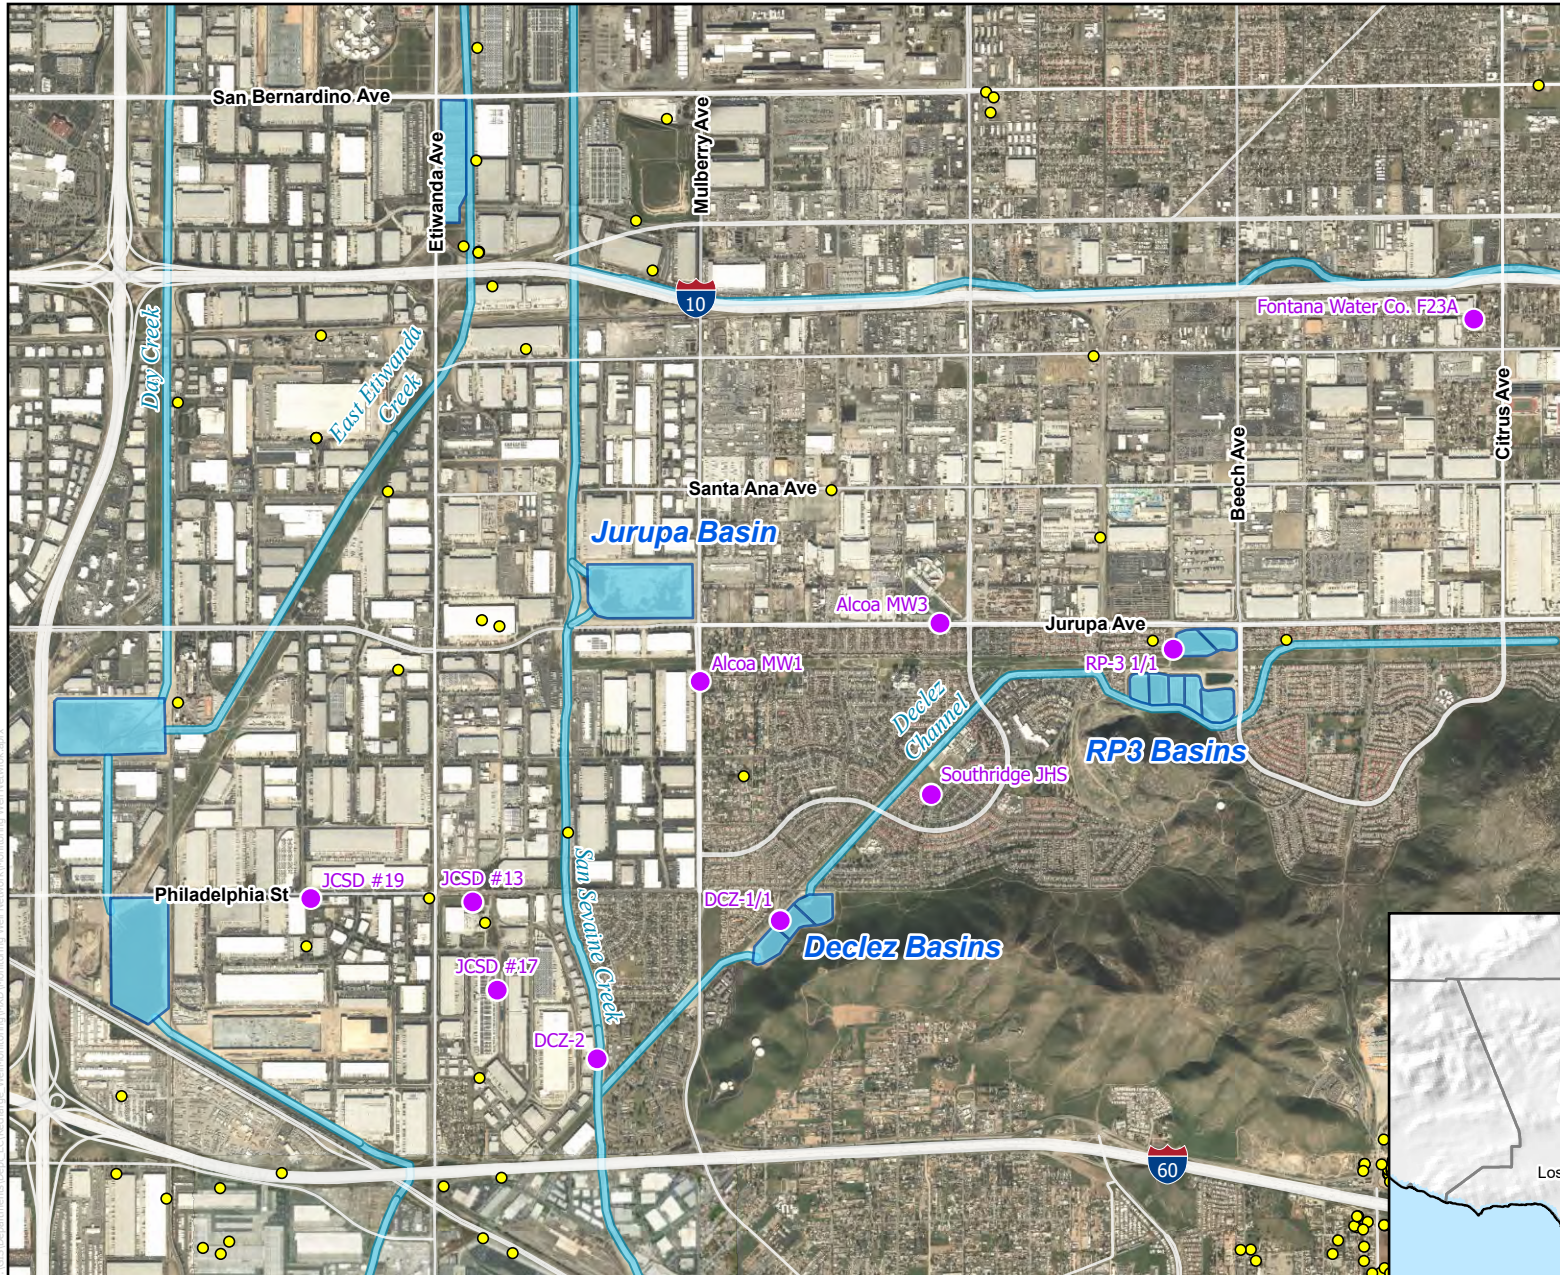


Main Map Features


- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin



Monitoring Well Network
 Declez and RP3 Basins
Figure 2-6

Recycled Water Recharge Program



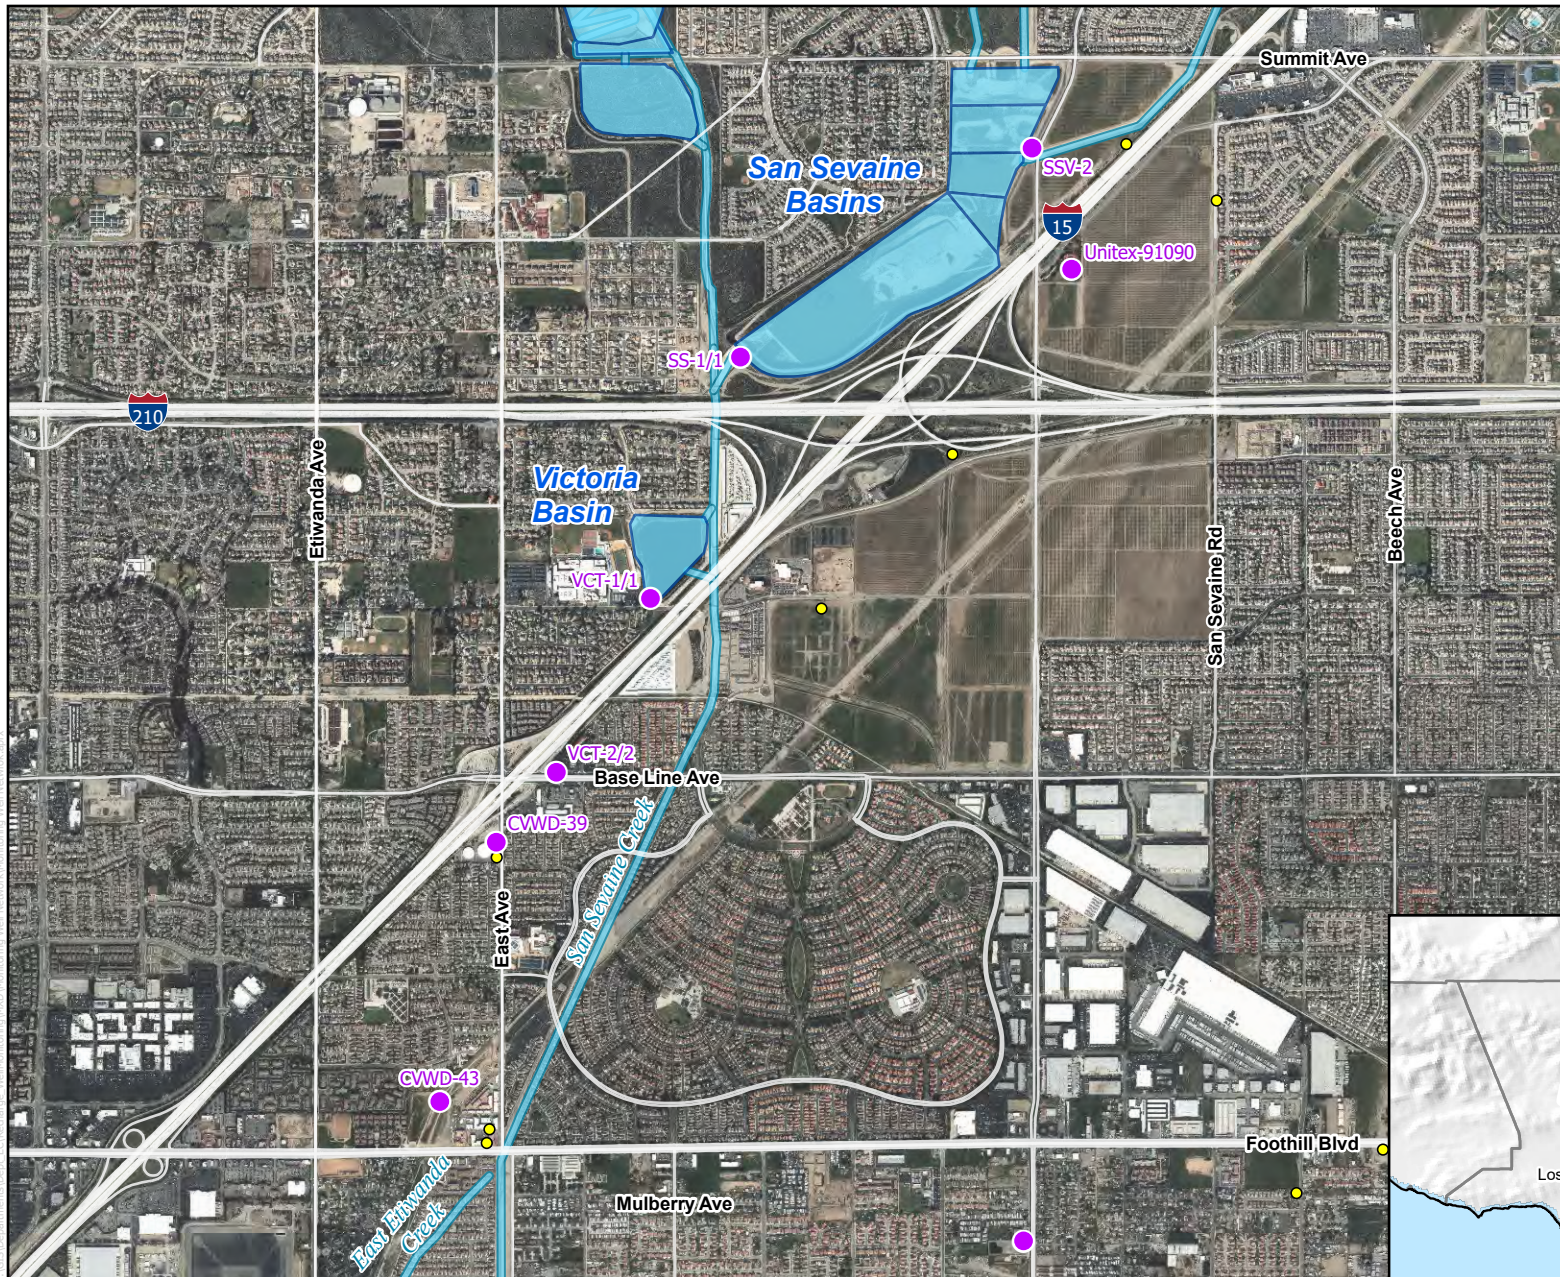

Main Map Features

- Monitoring Well
- Other Well
- River/Stream/Creek
- Recharge Basin



Monitoring Well Network San Sevine and Victoria Basins

Figure 2-7

Recycled Water Recharge Program

